

**CUSTOMER APPROVAL OF DESIGN I/C:**

SIGNATURE: \_\_\_\_\_  
 PRINTED NAME: \_\_\_\_\_ DATE: \_\_\_\_\_

Please review Center Point Energy design for installing Natural Gas to your facility. Verify the route of the Service Line and Meter Location on the building. If there is a conflict please contact the Designer or Sales Rep as shown in the Title Block. Before a natural gas service lines can be installed, you must clearly mark all privately-owned underground facilities including: septic tanks, drain fields, sewer lines, water wells, sprinkler systems, invisible fences, electric lines and pipelines. CenterPoint Energy and its representatives are not responsible for damage to these items if they are not clearly marked at time of installation.

WHEN BUTT FUSING TO EXISTING IN-SERVICE POLYETHYLENE, VISUALLY INSPECT FOR THE PRESENCE OF HYDROCARBON PERMEATION IMMEDIATELY AFTER REMOVING FUSION IRON. IF ANY BUBBLING IS IDENTIFIED ON THE HEATED SURFACE, DO NOT JOIN TO NEW PE PIPE. ALLOW TO COOL AND CUT THIS END OFF (12" LENGTH) AND SEND TO THE GOLDEN VALLEY LAB WITH STREET LOCATION AND W.O. #. COMPLETE TIE- IN/EXTENSION USING AN ELECTROFUSION COUPLING(S). DOCUMENT IN FIELD NOTES.



PROPRIETARY AND CONFIDENTIAL

90851687  
 M16000 LITTLE FALLS

ONE CALL:  
 Morrison  
 \*NW30 T129/R29  
 \* = this Page


- LEGEND:
- ACTIVE
  - DESIGNED
  - PROPOSED
  - ABANDONED
  - ABANDONED

- Interruptible
- Existing
- Normal
- Future
- Proposed

W/O# 90851687 Install I/C Service-Plastic-Conversion - CSV  
 \* GOPHER GUARD CITY 2" PIPE REQUIRED \*  
 INSTALL: 4"IPS X 2"IPS TR HVPT ELECTROFUSION TEE  
 W/ 1.88" TAP SIZE @ 31' WCL LIDBERGH DR S  
 \* DIRECTIONAL BORE @ 60" MIN DEPTH UNDER COUNTY RD 52 &  
 INTO GRASS AREA PAST PARKING LOT \*  
 INSTALL: 167' OF 2" IPS PE 2406/2708 CL-2 SVC LINE  
 W/ 1-1/4" STYLE F ANODELESS RISER W/ BYPASS, W/SLEEVE  
 @ 2'LRBL NEXT TO ELEVATOR SHAFT  
 SVC EQUIP# 64623211

W/O# I/C Install SmVol Gas Meter - CSV  
 \* MOUNT METER ON POST NEXT ELEVATOR SHAFT \*  
 INSTALL: 425TC OSM ERT'D METERSET (CL-2 398CFH)  
 W/ 3/4" X 1" 1813C REG @2#PSI, W/ 3/8" ORIFICE  
 OFF 1-1/4" STYLE F ANODELESS RISER W/BYPASS, W/SLEEVE  
 @ 2'LRBL NEXT TO ELEVATOR SHAFT  
 MTRSET# 15272386

METER ON POST  
 2' FROM CORNER NEXT  
 TO ELEVATOR SHAFT

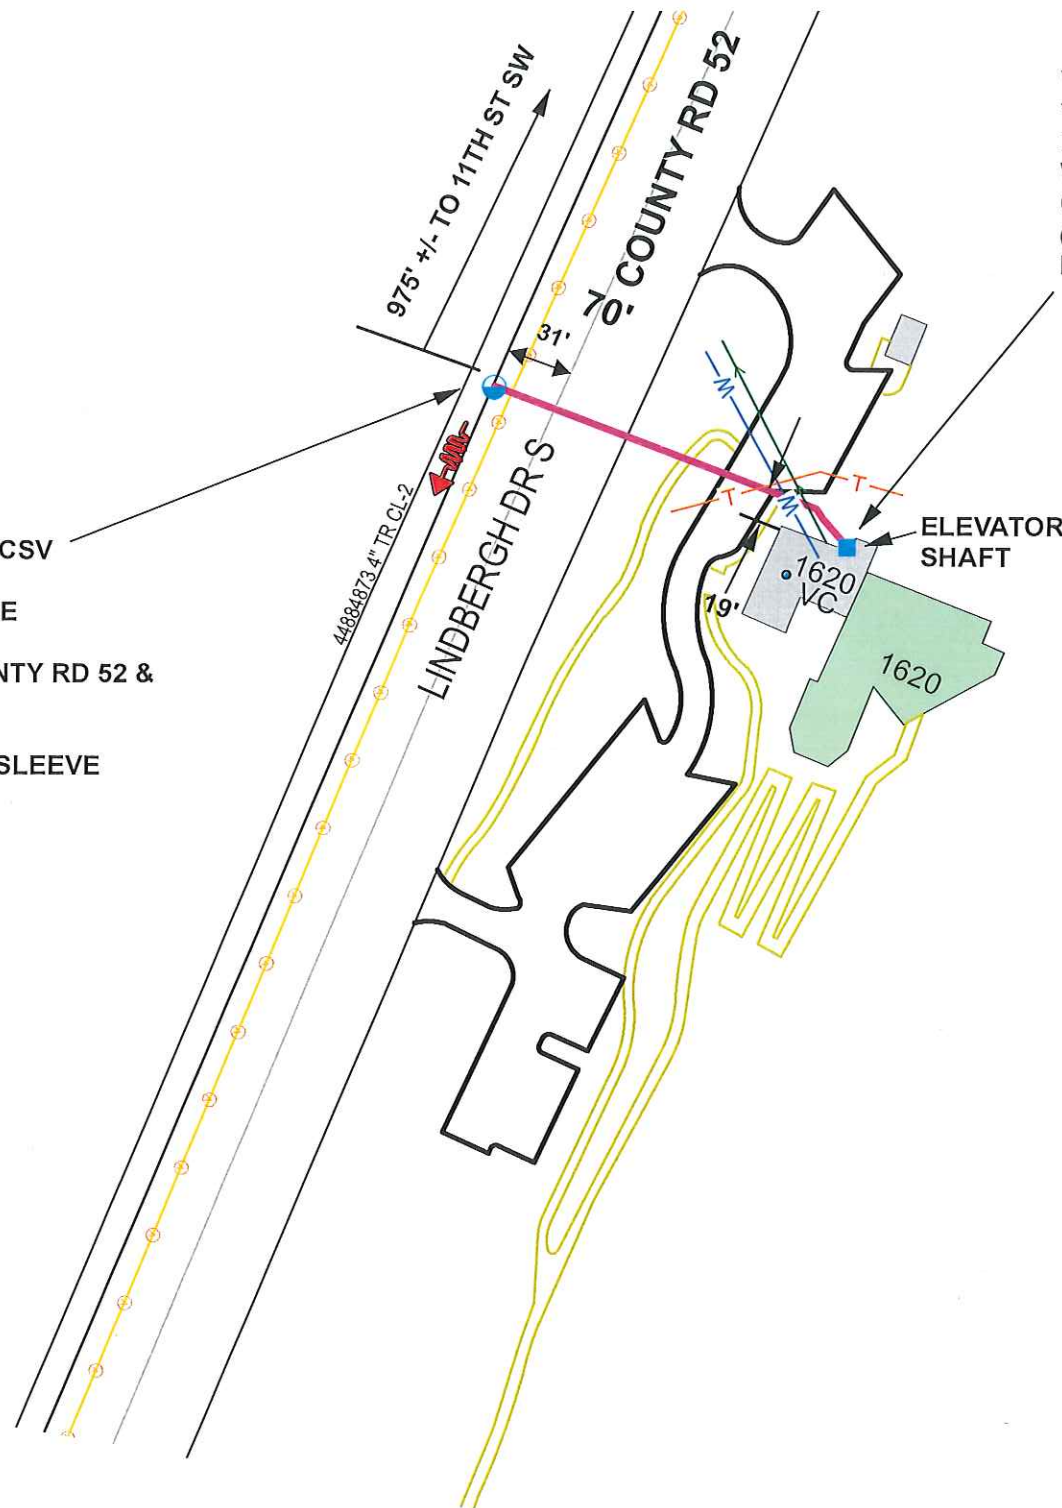

Address: 1620 LINDBERGH DR S  
 Customer: CHARLES LINDBERGH  
 VISITOR CTR  
 Contact Person: VALERIE HEIDER  
 Contact Phone: 630-390-8515  
 Sales Rep: PERRY SCHMIDT  
 Sales Rep Phone: 763-785-5427  
 Construction Hotline: 612-321-5310  
 Copies To Pipeline Integrity: No  
 Curb Valve: No  
 Copies to Corrosion: No  
 Corrosion Approval: N/A  
 Follow Internal Pipe Sampling  
 Requirements? No  
 GFIP#: NA  
 Permits: MORRISON CO RD 52  
 Requested Install Date: 09-08-19  
 Approval: JGM 7/19/19

PROJECT DESCRIPTION:  
 CHARLES LINDBERGH VISITOR CENTER

DESIGNER: Ronald McKibbon  
 PHONE #: 612-321-5492  
 DRAWN BY: Ronald McKibbon  
 DESIGN DATE: 7/19/2019

Revised Print  
 Destroy All Others  
 Revision History  
 Date:  
 Description:  
 Design Approval:

IC Services 1" : 80'  
 SCAN DATE: SHEET 1 OF 1

DESIGNER EXPRESS DESIGN

7/19/2019 2:56:50 PM