



COVERSHEET

	RUS Code: 100	W/O #: 462738
	EXT 740 C: 10	WP #:
	Loan Nbr: BB8	LOC #: 73-000-18-06105
	Loan Ywr: 2017	Name: GORDON M JOHNSON
	AFF #:	(H) Phone #:
	Elec: Kummet Electric (BRIAN)- OWNER I	(W) Phone #:
	RFCd: 7/19/2019 12:00:00 AM	(C) Phone #:
	By: GABE ACKERMAN	Acct #: 35531701

City:	Staked By: LUKE M KASELLA
Sec: 18	Date: 7/22/2019 12:00:00AM
Twp: 042	Signed By: GABE ACKERMAN
Rg: 29	07/05/2019

Tailgate Session	
Job Steps:	Work Procedures:
PPE Needed:	Job Hazards:
Source Control Verified/Size:	Equipment Needed:
Personal Tools:	1-Shot/K-Fuse Size:
Crew:	Date:
Comments:	

Gopher State	
Locate #:	Date OK: 07/24/2019 9:00


PLEASE DO JOB 7-26-19.
Comments 2:
Comments 3: KUMMETT WILL HAVE METER LOOP ON SITE

Septic:	Row 1:	Rd Permit: <input checked="" type="checkbox"/>
Priv Elec:	Row 2:	Cty Permit:
LP Line:	Line Ext \$ 5,020.00 Bore/Push \$ Permit \$ 50.00 Ped/Loop \$ 0.00 Total \$ 5070.00	Fees: <input checked="" type="checkbox"/>
Sprinkler:	Backfill Comments:	TWP Permit:
Final Grade:		State Permit:
Brushing:		DNR Permit:
Trees:		Joint Trench:
Easements:		Notify TWP:

Type of Device: Fuse	Size of Device: FUS-12T	Box/Switch #:
----------------------	-------------------------	---------------

Reel ID:	Start Ftg:	End Ftg:
Reel ID:	Start Ftg:	End Ftg:

CONDUCTOR SUMMARY			
STATUS	CONDUCTOR	TYPE	QTY (FT)
INSTALL	4 ACSR	PRIMARY	1588
	4/0 USE	SECONDARY	106
INSTALL	3/8 Steel Guy		82

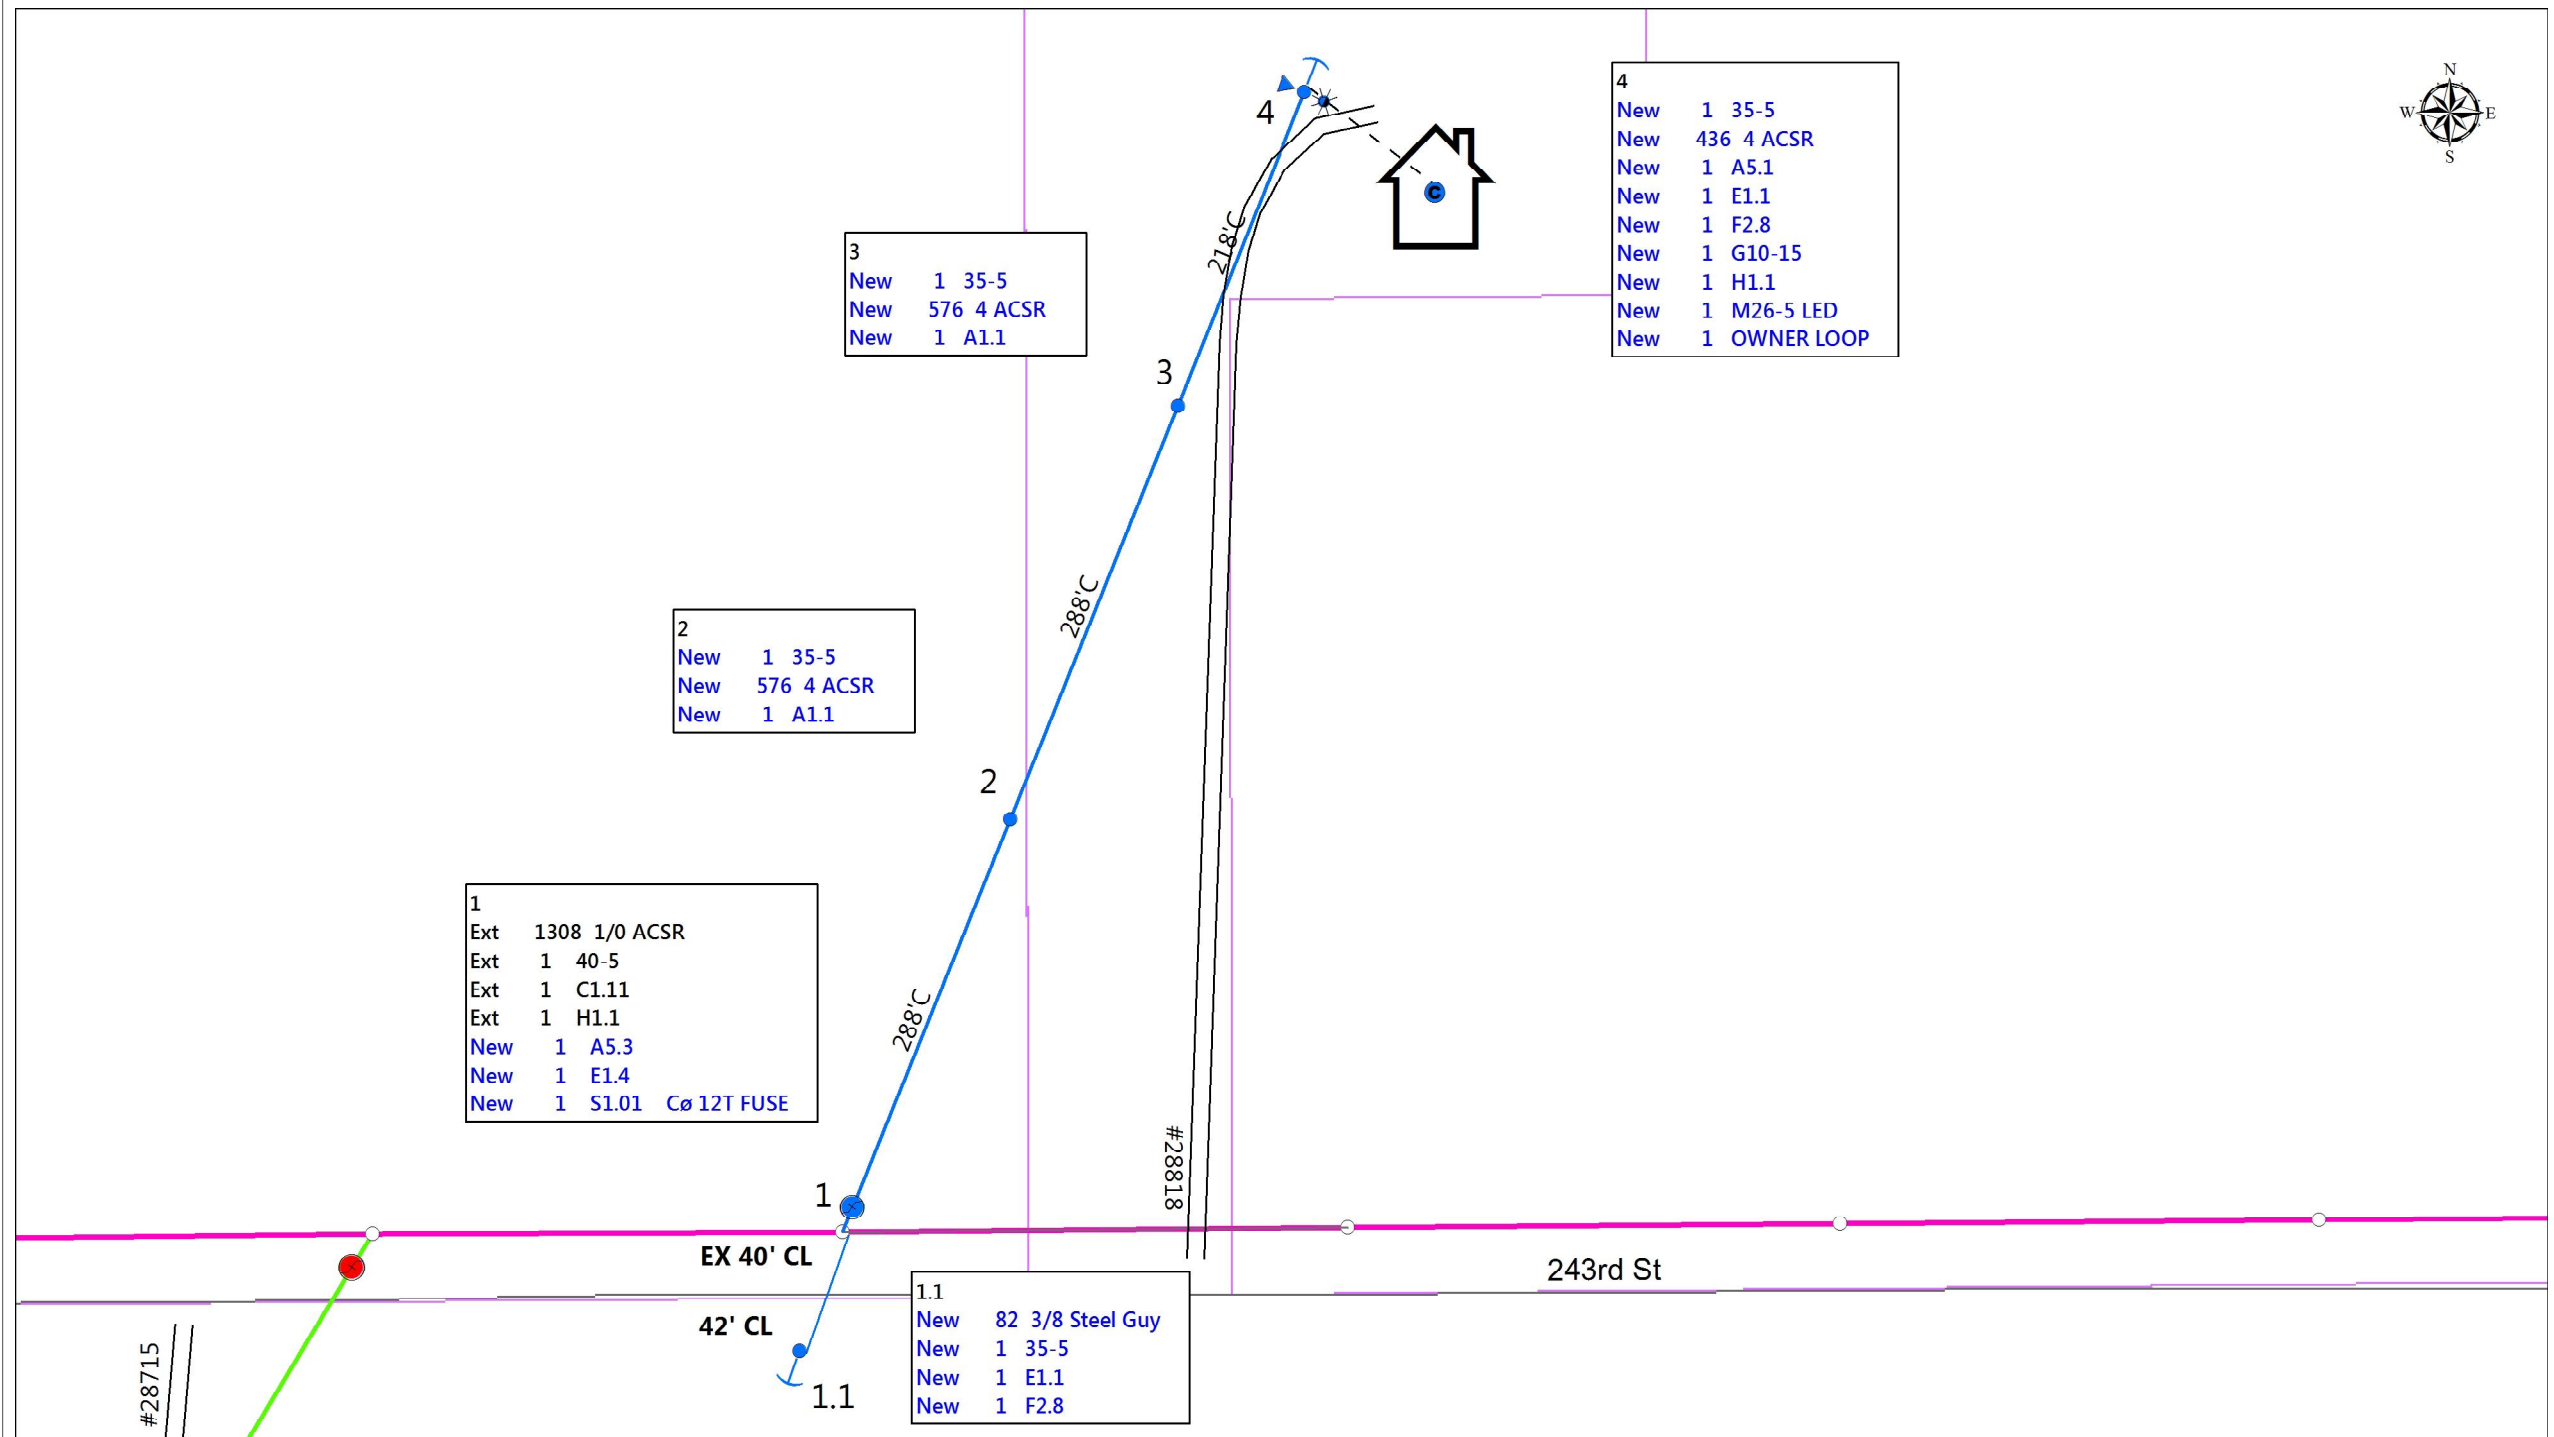

1
Ext 1308 1/0 ACSR
Ext 1 40-5
Ext 1 C1.11
Ext 1 H1.1
New 1 A5.3
New 1 E1.4
New 1 S1.01 CØ 12T FUSE

2
New 1 35-5
New 576 4 ACSR
New 1 A1.1

3
New 1 35-5
New 576 4 ACSR
New 1 A1.1

4
New 1 35-5
New 436 4 ACSR
New 1 A5.1
New 1 E1.1
New 1 F2.8
New 1 G10-15
New 1 H1.1
New 1 M26-5 LED
New 1 OWNER LOOP

1.1
New 82 3/8 Steel Guy
New 1 35-5
New 1 E1.1
New 1 F2.8

#28715

EX 40' CL

42' CL

#28818

243rd St