

94030910
M16000 LITTLE FALLS

ONE CALL:
Morrison
*NW17 T129/R29
* = this Page

LEGEND:
 ACTIVE
 DESIGNED
 PROPOSED
 ABANDONED
 ABANDONED


Interruptible
 Existing
 Normal
 Future
 Proposed

Address: 1113 W River Road
 Customer: Morrison County
 Contact Person: Michael Filippi
 Contact Phone: 320-630-5307
 Sales Rep: Perry Schmidt
 Sales Rep Phone: 612-749-7462
 Construction Hotline: 612-321-5310
 Copies To Pipeline Integrity: No
 Curb Valve: No
 Copies to Corrosion: Yes
 Corrosion Approval: Paul Teeselink
 Follow Internal Pipe Sampling Requirements? No
 GFIP#: N/A
 Permits: Yes - Morrison County
 Requested Install Date: 06/07/2020
 Approval: 5/8/20

PROJECT DESCRIPTION:
MORRISON CO PUB SAFETY ANNEX

DESIGNER: TJ Dehne
 PHONE #: 612-321-5426
 DRAWN BY: TJ Dehne
 DESIGN DATE: 5/8/2020


Revised Print
 Destroy All Others
 Revision History
 Date:
 Description:
 Design Approval:

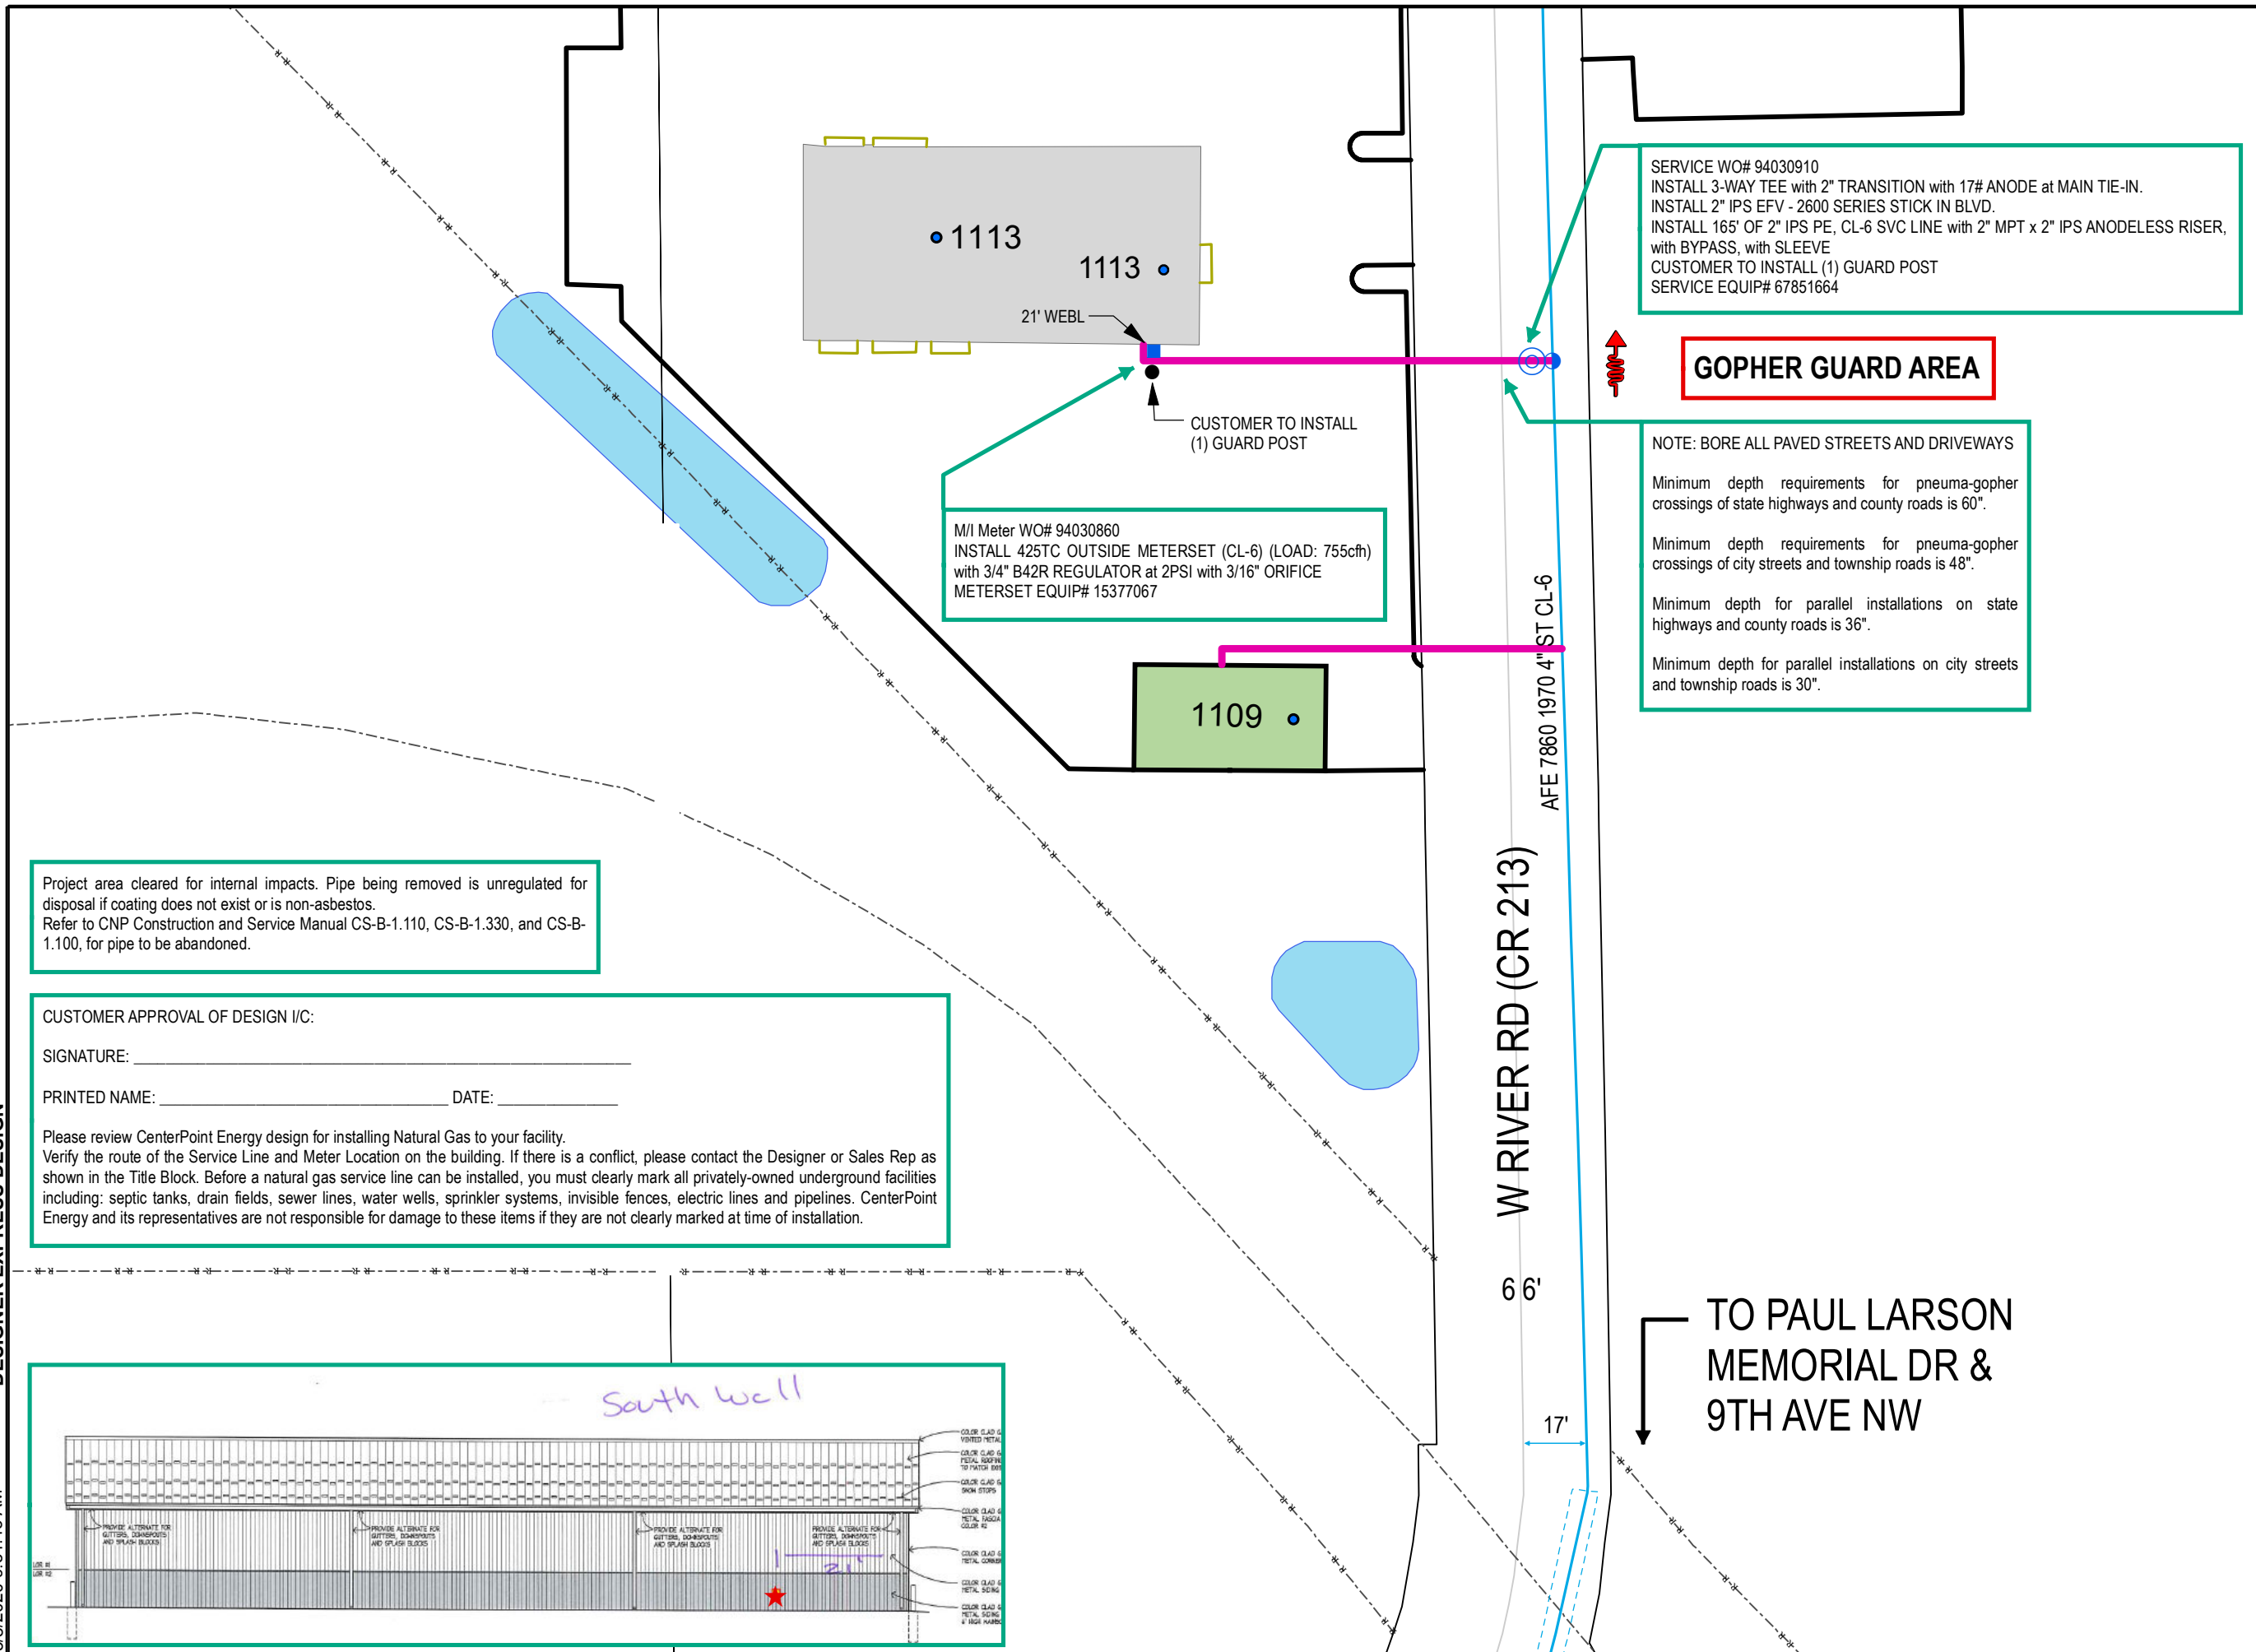

Project area cleared for internal impacts. Pipe being removed is unregulated for disposal if coating does not exist or is non-asbestos. Refer to CNP Construction and Service Manual CS-B-1.110, CS-B-1.330, and CS-B-1.100, for pipe to be abandoned.

CUSTOMER APPROVAL OF DESIGN I/C:
 SIGNATURE: _____
 PRINTED NAME: _____ DATE: _____

Please review CenterPoint Energy design for installing Natural Gas to your facility. Verify the route of the Service Line and Meter Location on the building. If there is a conflict, please contact the Designer or Sales Rep as shown in the Title Block. Before a natural gas service line can be installed, you must clearly mark all privately-owned underground facilities including: septic tanks, drain fields, sewer lines, water wells, sprinkler systems, invisible fences, electric lines and pipelines. CenterPoint Energy and its representatives are not responsible for damage to these items if they are not clearly marked at time of installation.

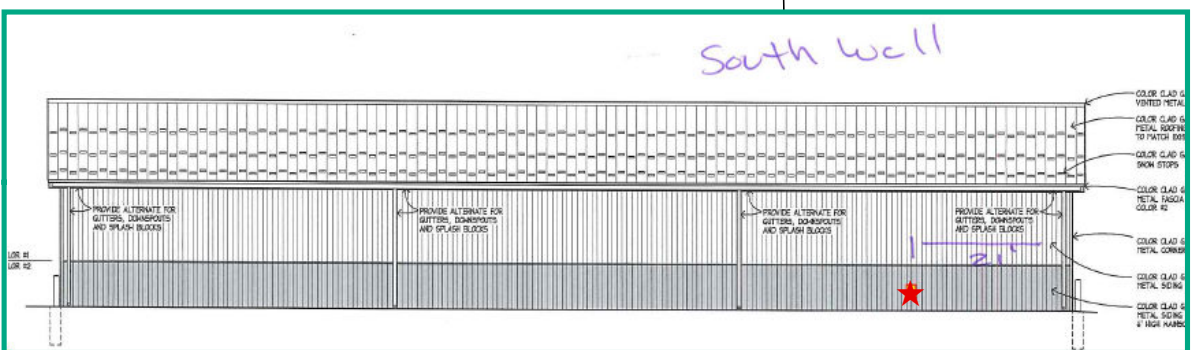

DESIGNER EXPRESS DESIGN 5/8/2020 9:34:43 AM