

ADDRESS: 9972 GREAT RIVER ROAD, LITTLE FALLS

DESIGN COMMENTS:

WCC COLLECTED: ☐ YES ☐ NO


WCC INCURRED: ☐ YES ☐ NO

ELECTRICIAN: Central MN Electric

ELECTRICIAN PH: 980-6075


RELATED WORK ORDERS:

TITLE: WILLIAM L NORNBERG




CITY LIMITS:

CONDUCTOR TYPE	LINE FEET	WIRES	TOTAL FEET
4 ACSR OH		2	1180
1/0 PRI AL URD		1	935
4/0 SEC URD		1	30

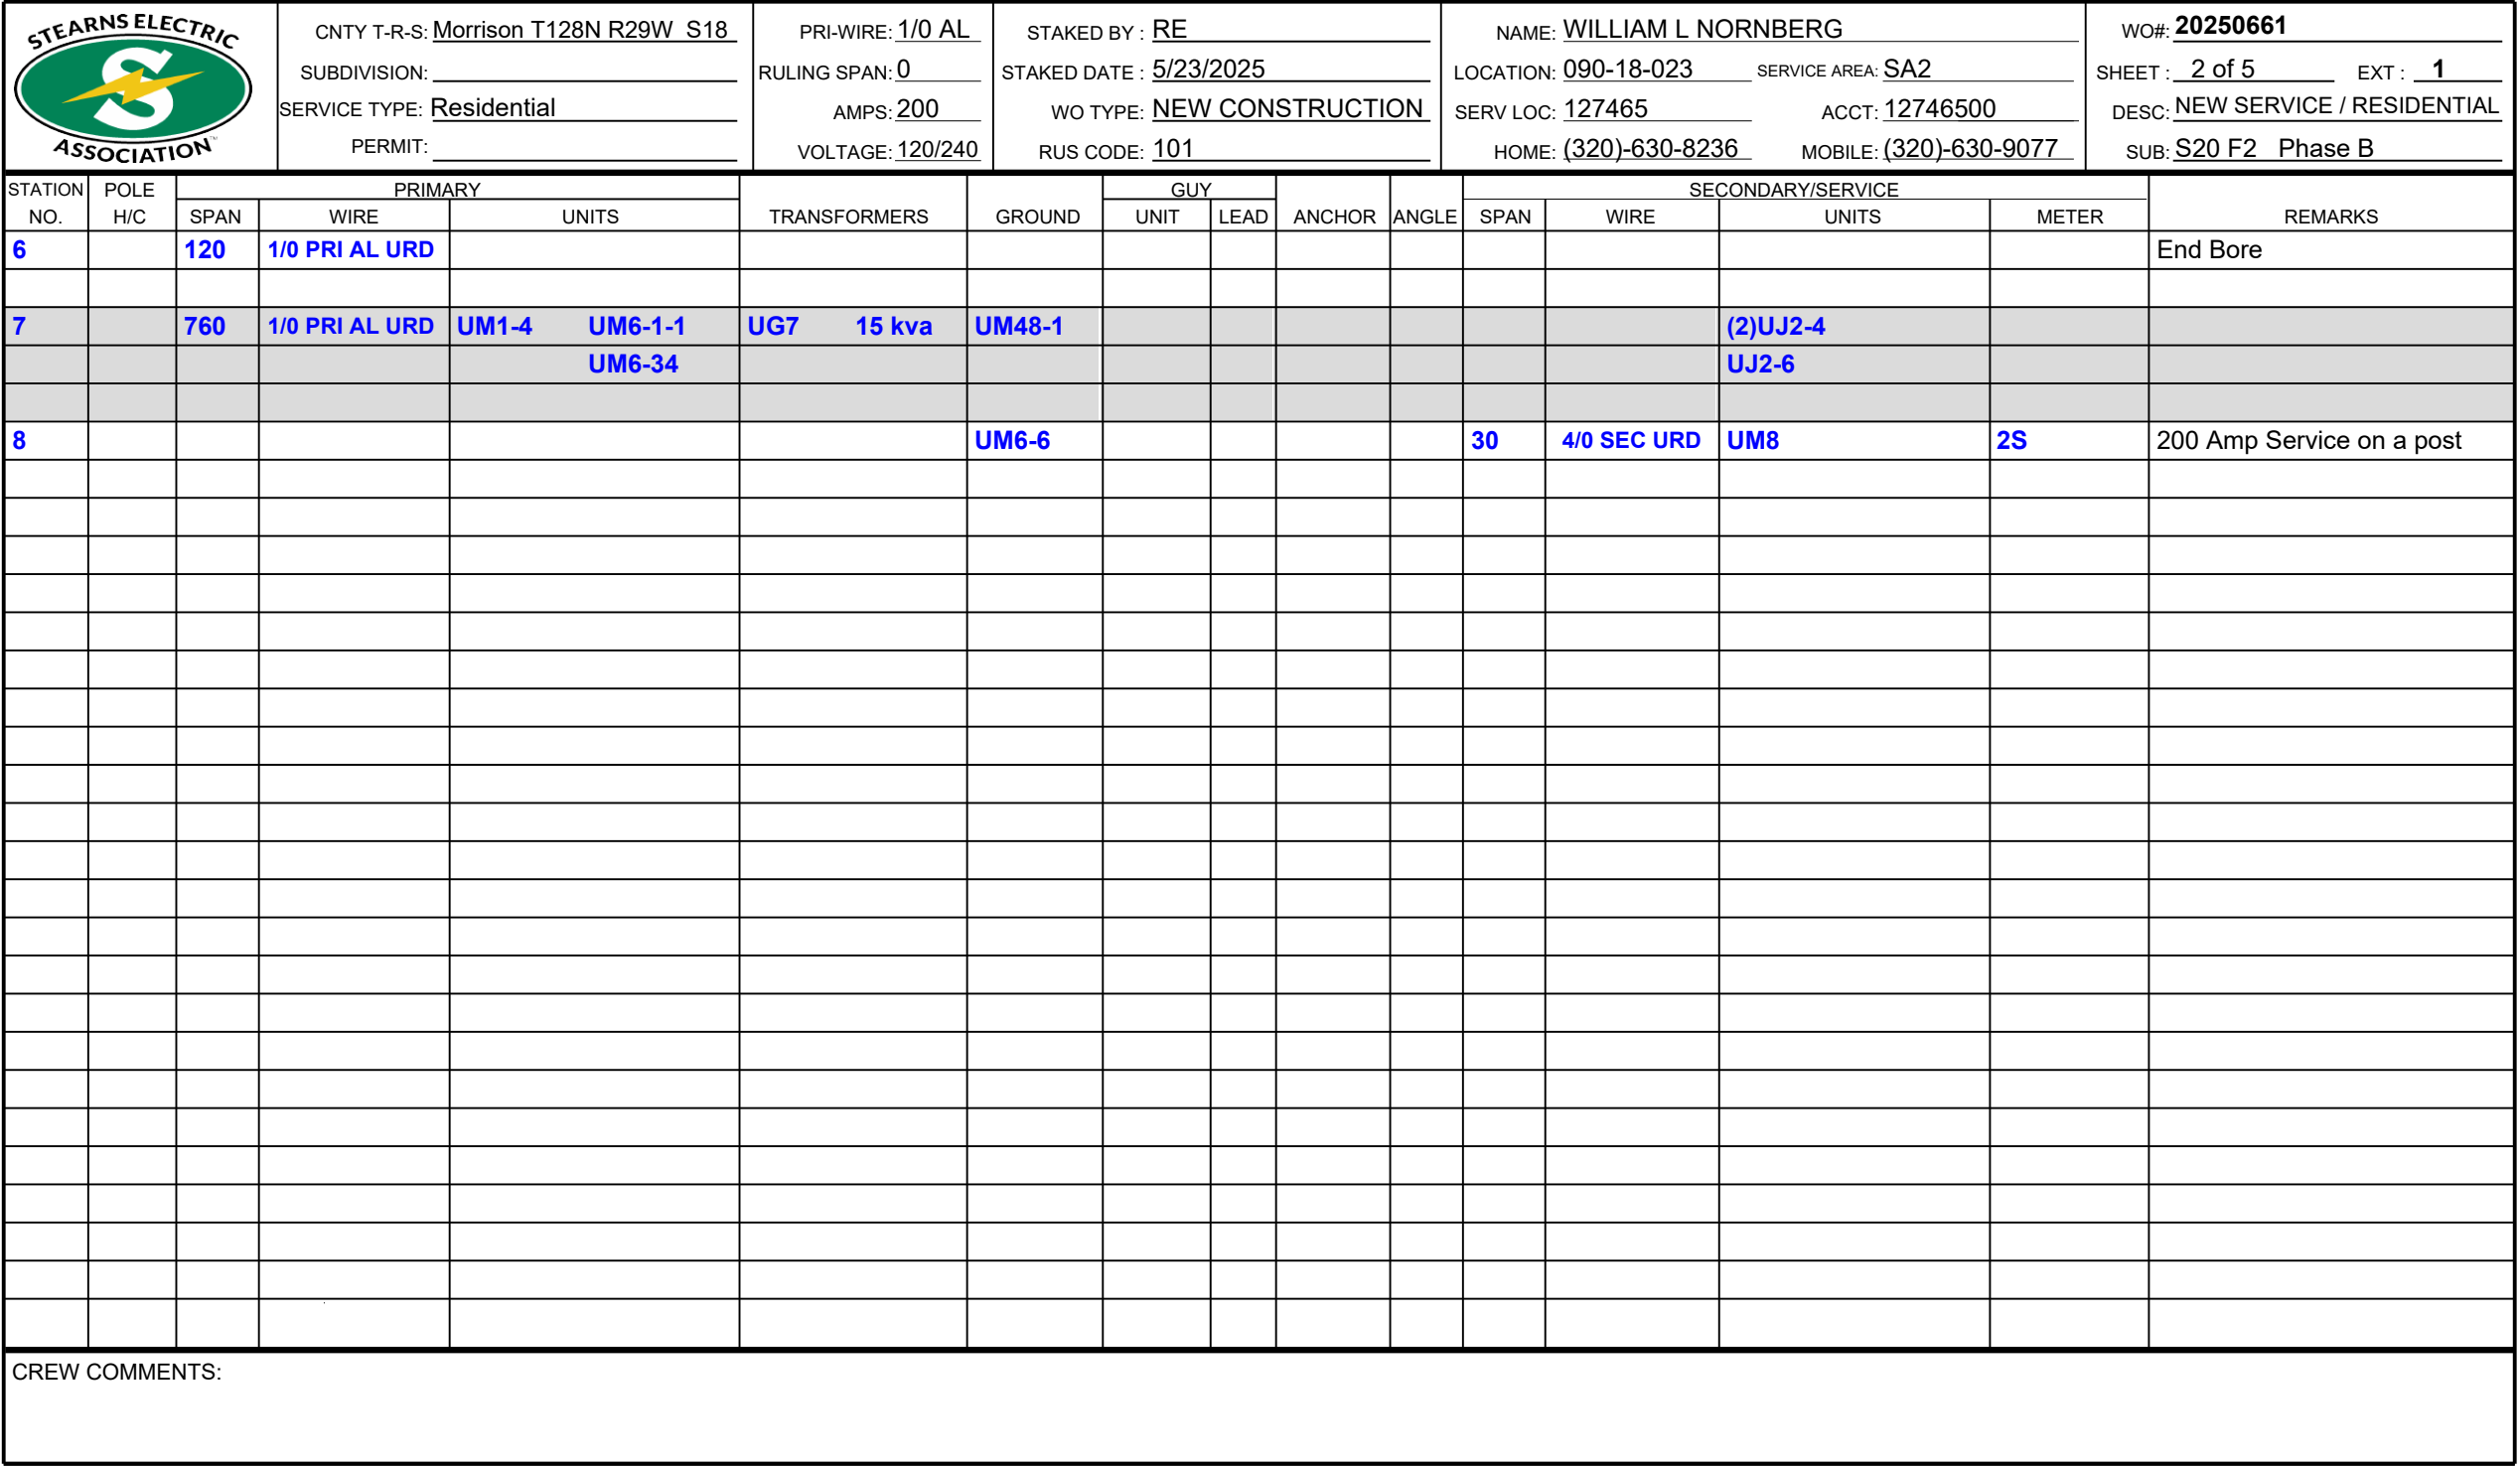




CNTY T-R-S: <u>Morrison T128N R29W S18</u>	PRI-WIRE: <u>1/0 AL</u>	STAKED BY: <u>RE</u>	NAME: <u>WILLIAM L NORNBERG</u>	WO#: <u>20250661</u>
SUBDIVISION: _____	RULING SPAN: <u>0</u>	STAKED DATE: <u>5/23/2025</u>	LOCATION: <u>090-18-023</u> SERVICE AREA: <u>SA2</u>	SHEET: <u>3 of 5</u> EXT: <u>1</u>
SERVICE TYPE: <u>Residential</u>	AMPS: <u>200</u>	WO TYPE: <u>NEW CONSTRUCTION</u>	SERV LOC: <u>127465</u> ACCT: <u>12746500</u>	DESC: <u>NEW SERVICE / RESIDENTIAL</u>
PERMIT: _____	VOLTAGE: <u>120/240</u>	RUS CODE: <u>101</u>	HOME: <u>(320)-630-8236</u> MOBILE: _____	SUB: <u>S20 F2 Phase B</u>

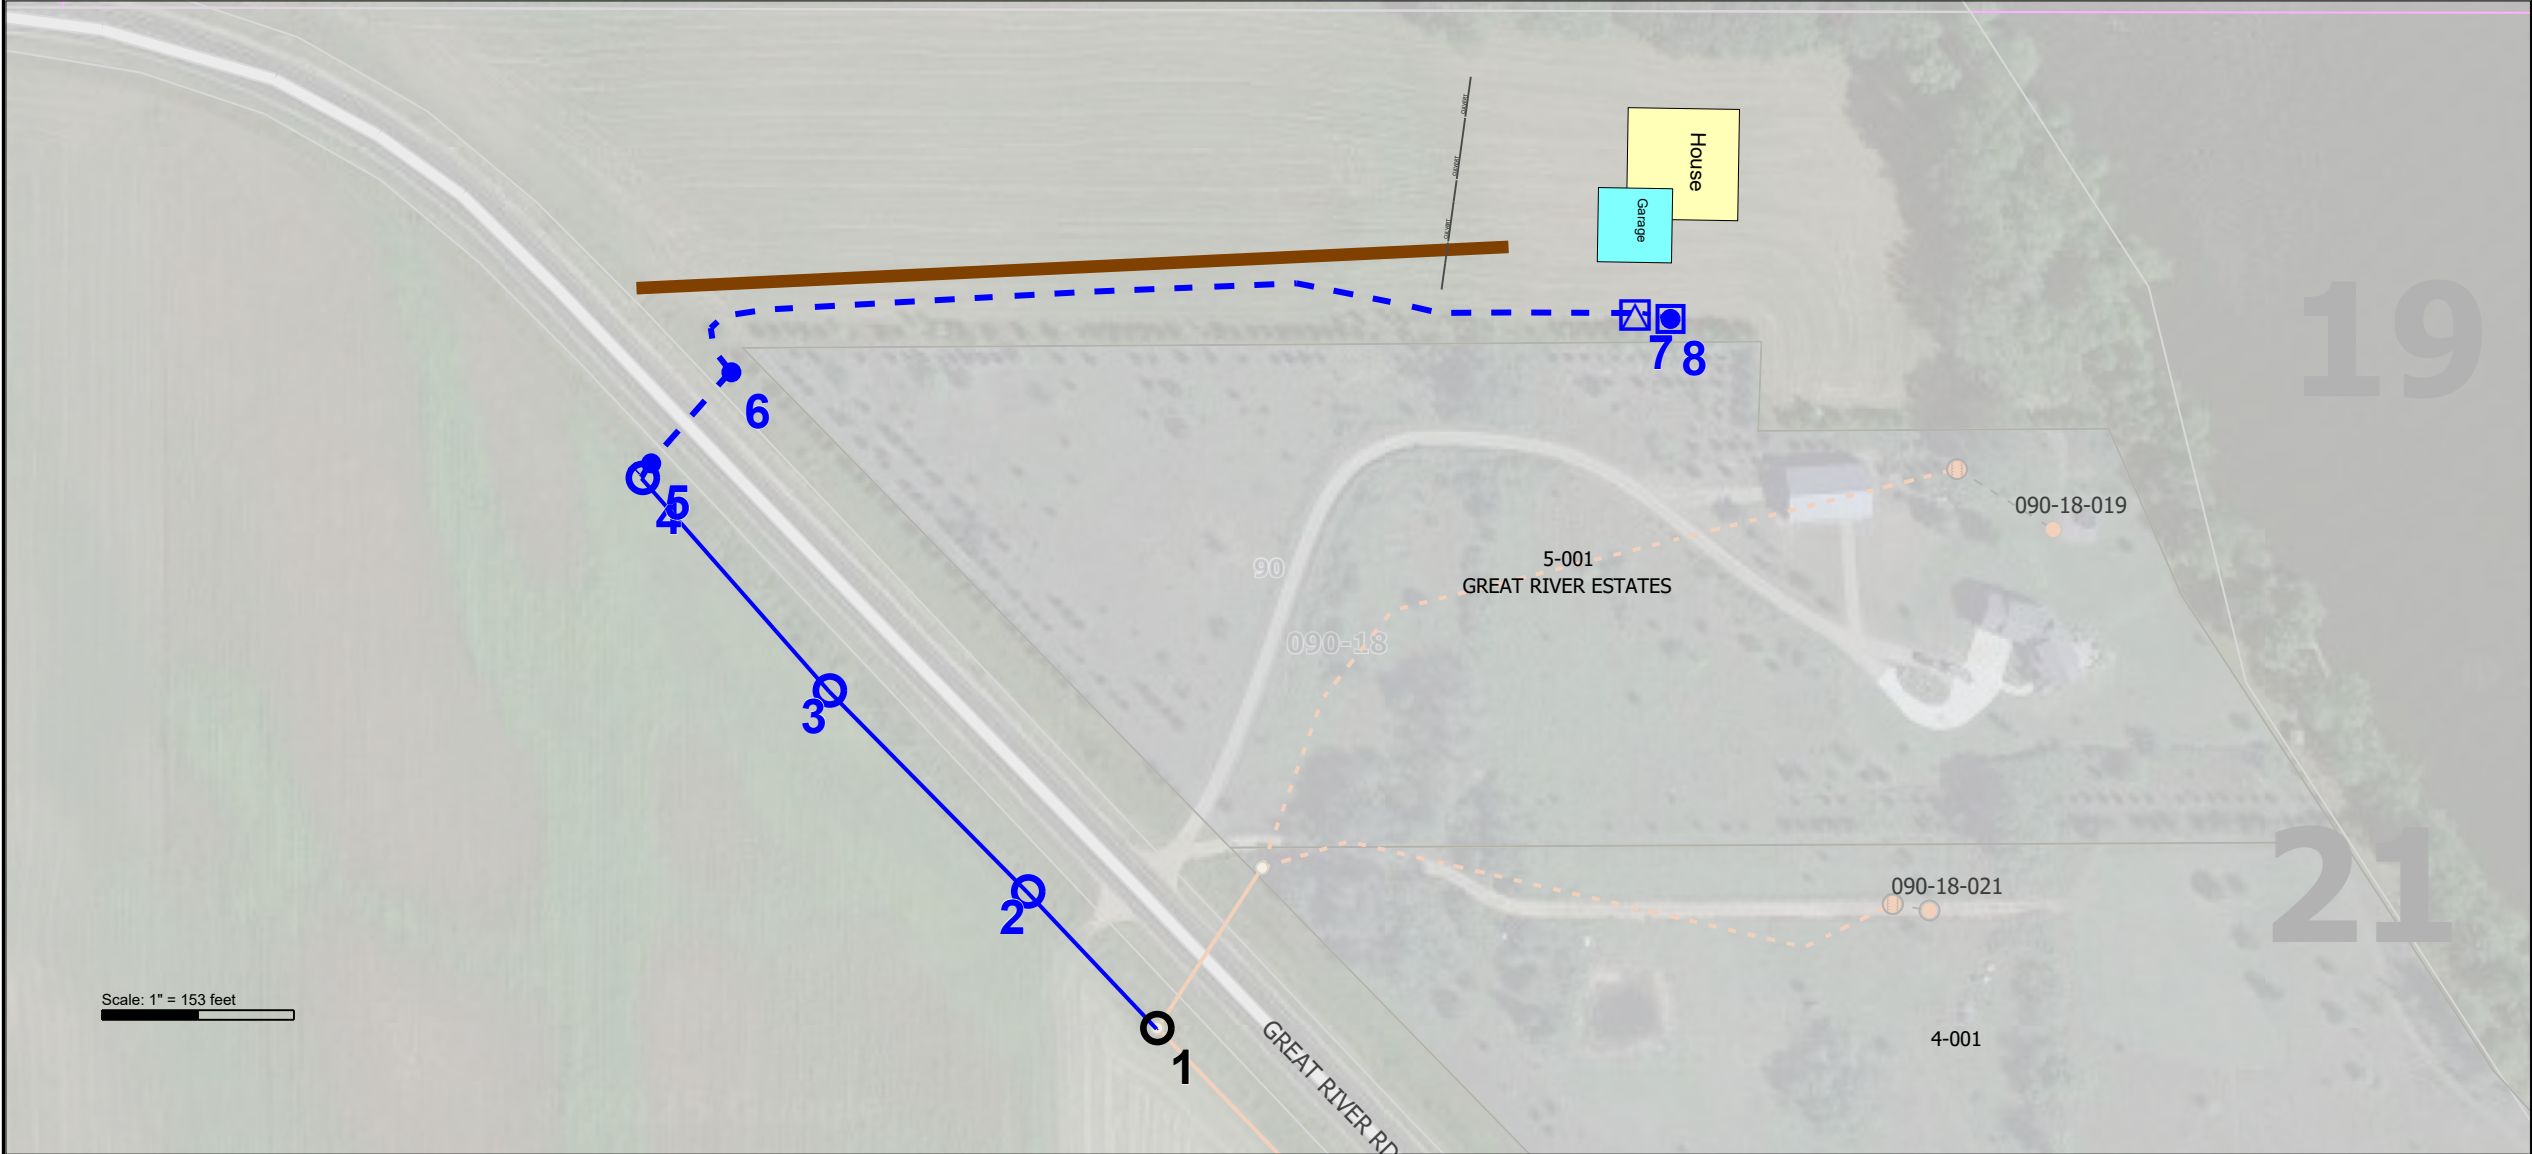


Blue - New Status	Staking Stations	...	Staking Span
Black - Existing Status	Pole	Padmount Transformer	Overhead
Red - Retire Status	Service Point	Primary Cabinet	Underground
		URD Point	






CNTY T-R-S: <u>Morrison T128N R29W S18</u>	PRI-WIRE: <u>1/0 AL</u>	STAKED BY : <u>RE</u>	NAME: <u>WILLIAM L NORNBERG</u>	WO#: <u>20250661</u>
SUBDIVISION: _____	RULING SPAN: <u>0</u>	STAKED DATE : <u>5/23/2025</u>	LOCATION: <u>090-18-023</u> SERVICE AREA: <u>SA2</u>	SHEET : <u>4 of 5</u> EXT : <u>1</u>
SERVICE TYPE: <u>Residential</u>	AMPS: <u>200</u>	WO TYPE: <u>NEW CONSTRUCTION</u>	SERV LOC: <u>127465</u> ACCT: <u>12746500</u>	DESC: <u>NEW SERVICE / RESIDENTIAL</u>
PERMIT: _____	VOLTAGE: <u>120/240</u>	RUS CODE: <u>101</u>	HOME: <u>(320)-630-8236</u> MOBILE: _____	SUB: <u>S20 F2 Phase B</u>

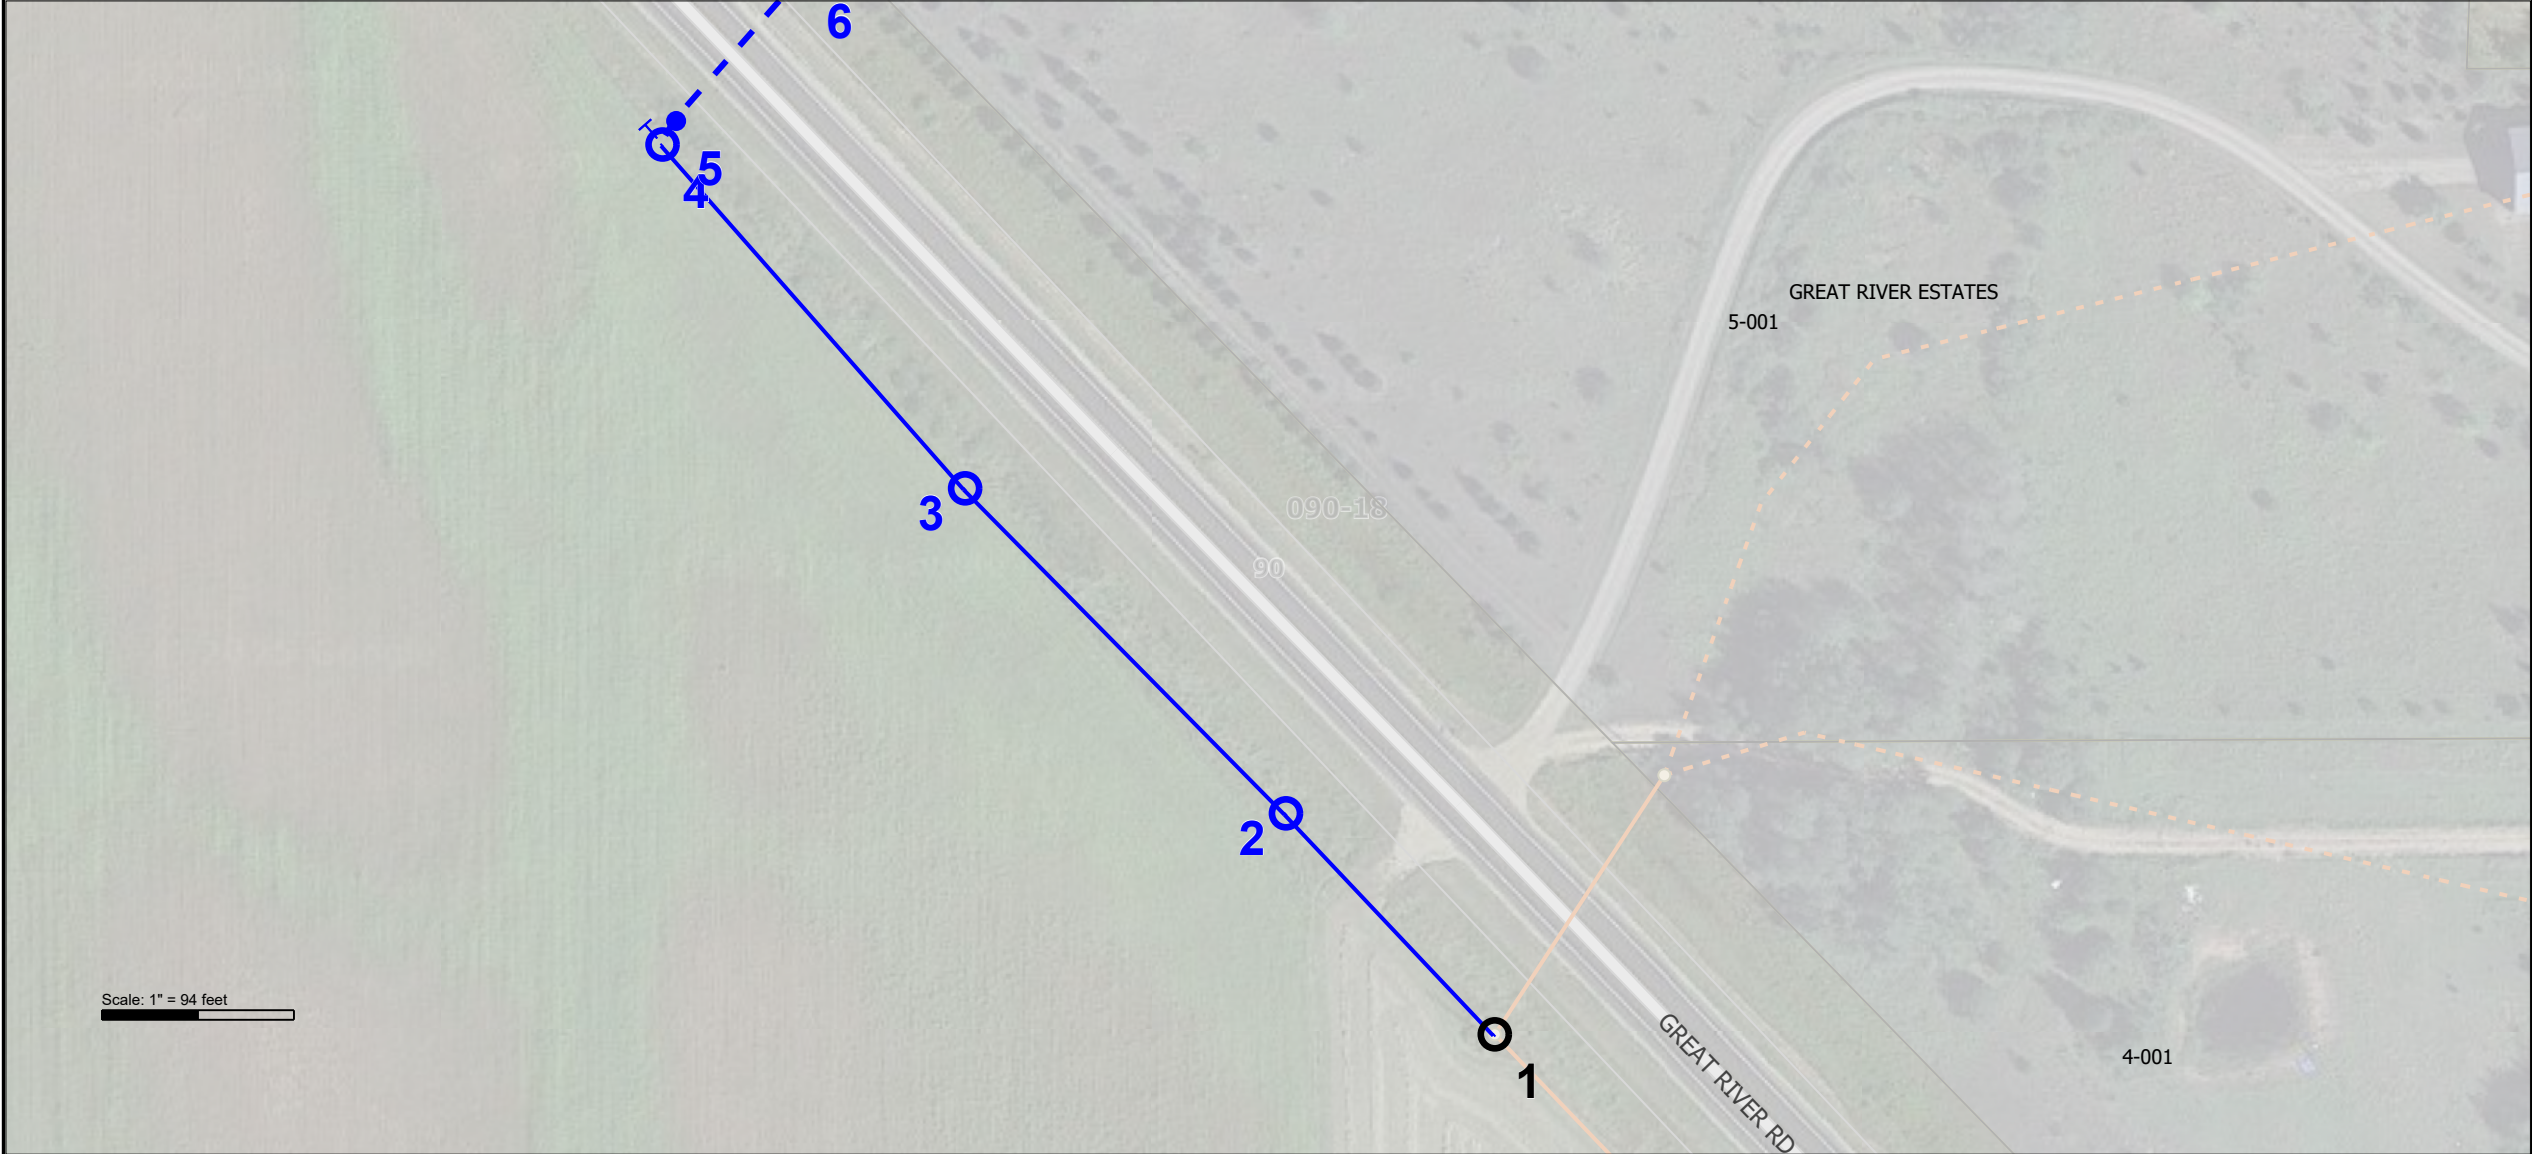


Blue – New Status	Staking Stations	...	Staking Span
Black – Existing Status	Pole	Padmount Transformer	Overhead
Red – Retire Status	Service Point	Primary Cabinet	Underground
		Secondary Pedestal	
		URD Point	





CNTY T-R-S: <u>Morrison T128N R29W S18</u>	PRI-WIRE: <u>1/0 AL</u>	STAKED BY : <u>RE</u>	NAME: <u>WILLIAM L NORNBERG</u>	WO#: <u>20250661</u>
SUBDIVISION: _____	RULING SPAN: <u>0</u>	STAKED DATE : <u>5/23/2025</u>	LOCATION: <u>090-18-023</u> SERVICE AREA: <u>SA2</u>	SHEET : <u>5 of 5</u> EXT : <u>1</u>
SERVICE TYPE: <u>Residential</u>	AMPS: <u>200</u>	WO TYPE: <u>NEW CONSTRUCTION</u>	SERV LOC: <u>127465</u> ACCT: <u>12746500</u>	DESC: <u>NEW SERVICE / RESIDENTIAL</u>
PERMIT: _____	VOLTAGE: <u>120/240</u>	RUS CODE: <u>101</u>	HOME: <u>(320)-630-8236</u> MOBILE: _____	SUB: <u>S20 F2 Phase B</u>

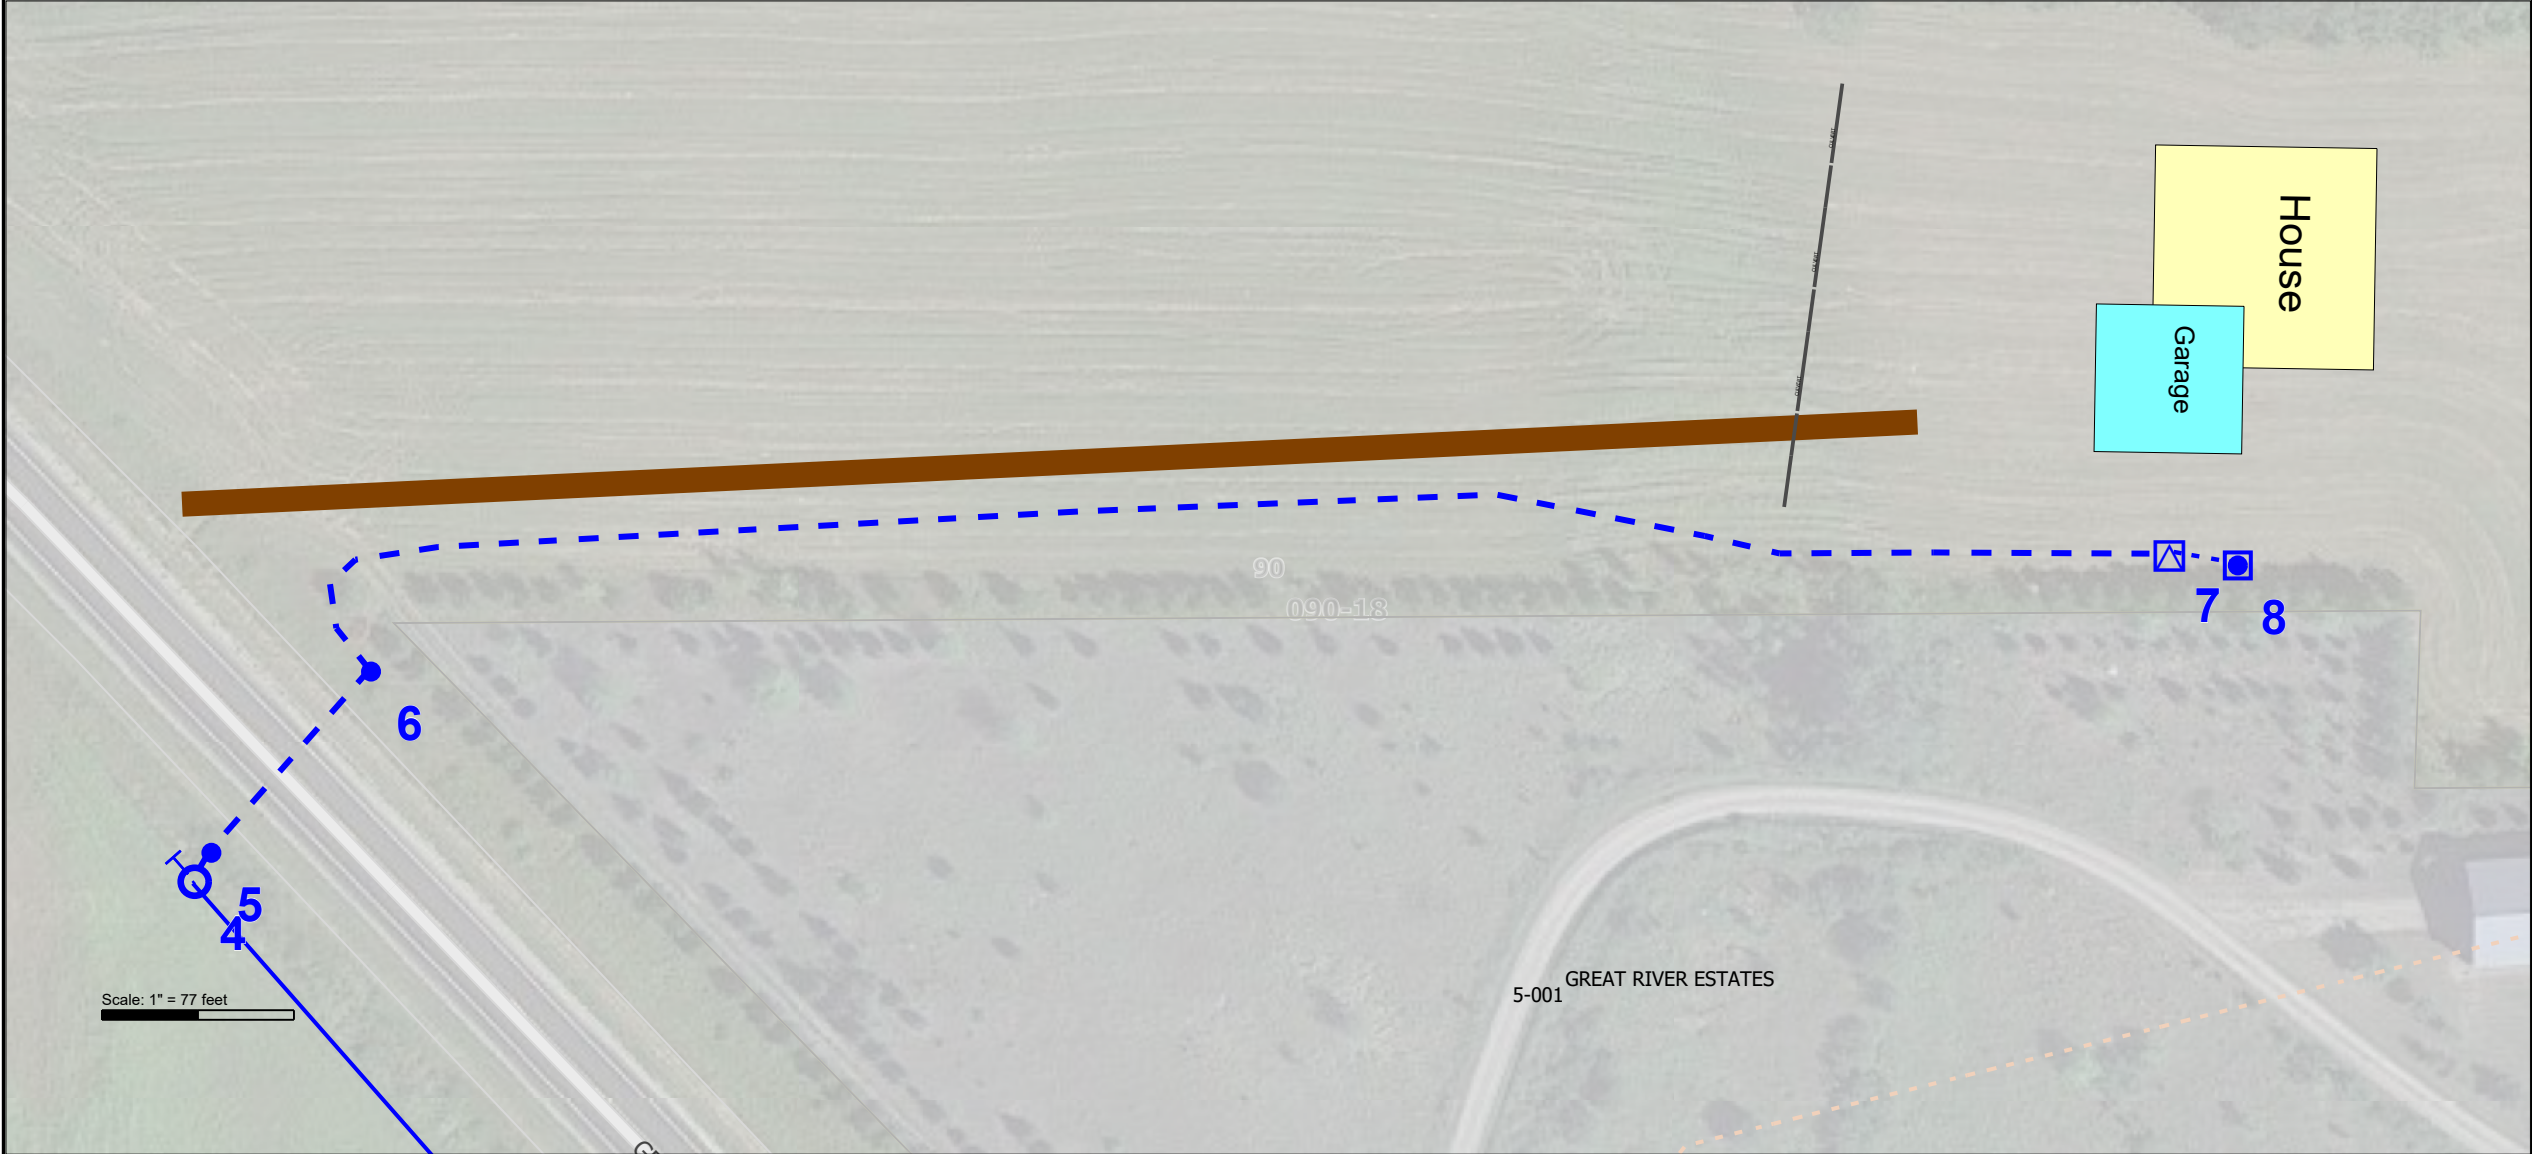

Blue – New Status	Staking Stations	Padmount Transformer	Secondary Pedestal	Staking Span
Black – Existing Status	Pole	Primary Cabinet	URD Point	Overhead
Red – Retire Status	Service Point			Underground

