


9/15/2025 9:21:52 AM

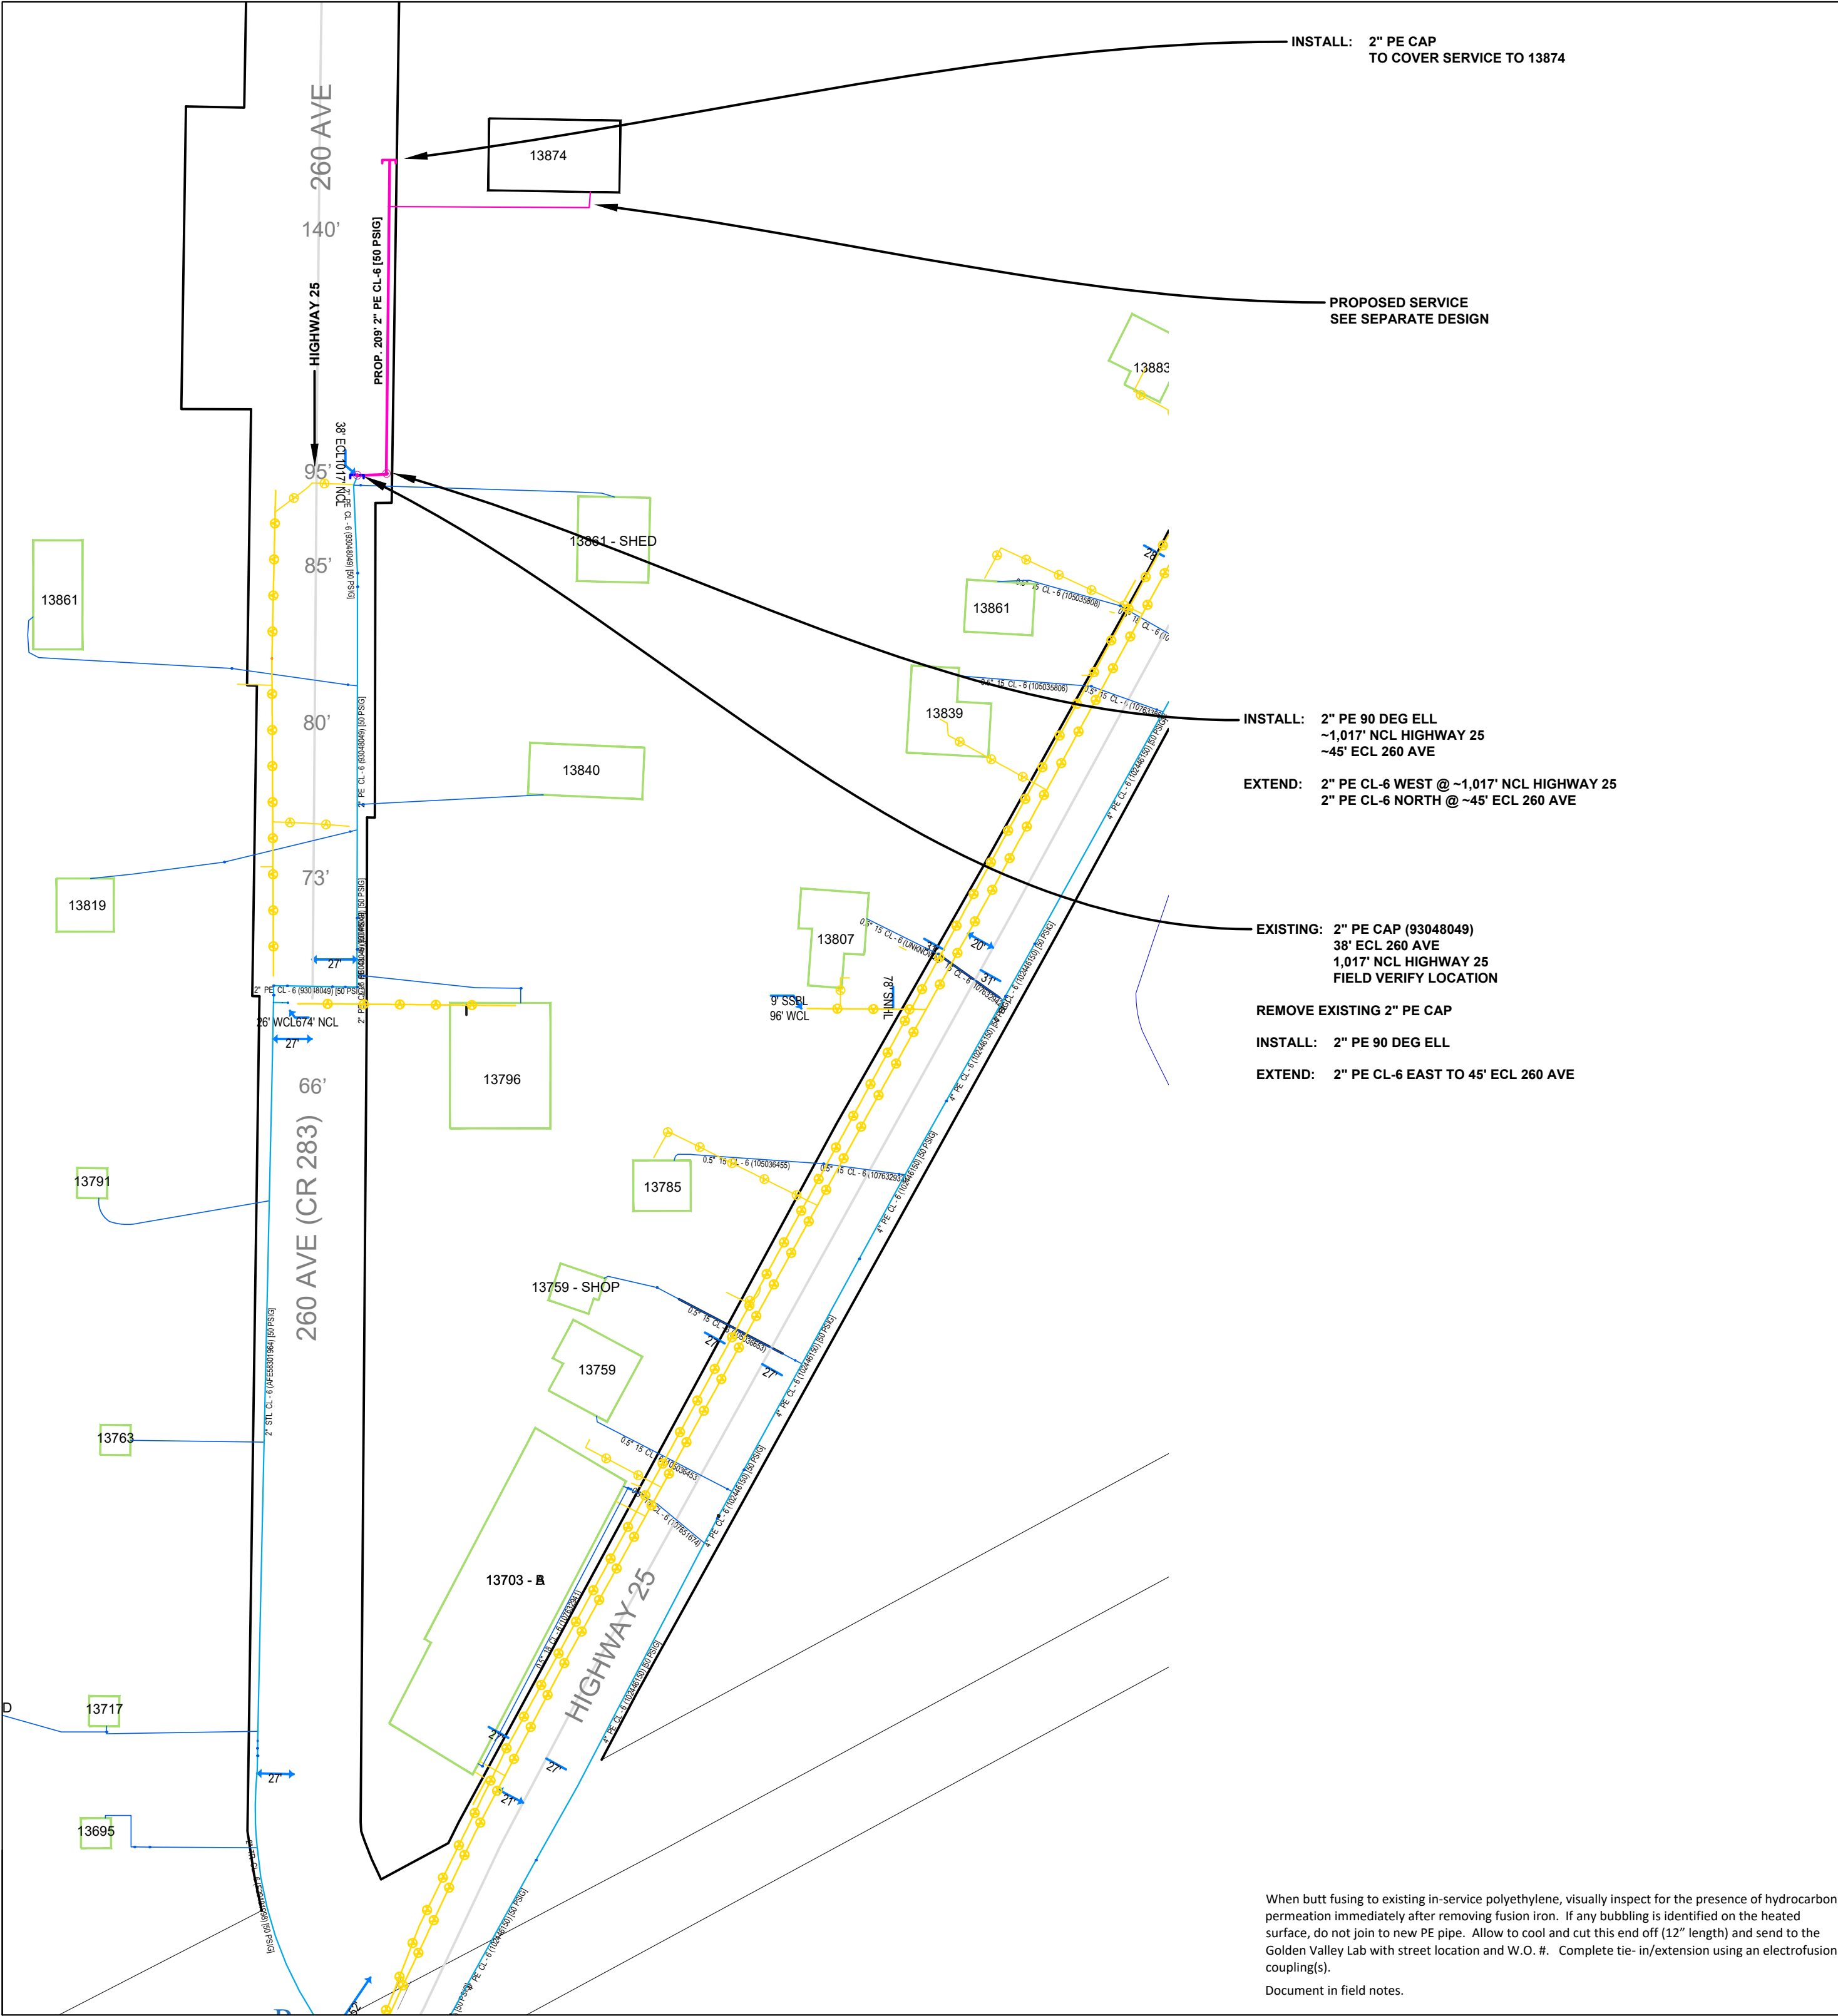

When butt fusing to existing in-service polyethylene, visually inspect for the presence of hydrocarbon permeation immediately after removing fusion iron. If any bubbling is identified on the heated surface, do not join to new PE pipe. Allow to cool and cut this end off (12" length) and send to the Golden Valley Lab with street location and W.O. #. Complete tie-in/extension using an electrofusion coupling(s).

Document in field notes.

NOTE: BORE ALL PAVED STREETS AND DRIVEWAYS
Minimum depth requirements for crossings of state highways and county roads is 60". Minimum depth requirements for crossings of city streets and township roads is 48". Minimum depth for parallel installations on state highways and county roads is 36". Minimum depth for parallel installations on city streets and township roads is 30". All steel pipe welds to be coated with 2 part epoxy.

INSTALL LOCATING POINTS AT A MAXIMUM SPACING OF 1,000 FT.

INSTALL 2" PE CL-6 ~ GAS ONLY ~ 31' ECL CR 283 (WITHIN MORRISON COUNTY ROW)

Install; Clean and Test; and Put in Service; Proposed new main per CenterPoint Energy Construction and Service Manual.

Purge new main until essentially 100% gas reading is obtained on Combustible Gas Indicator. See CenterPoint Energy Construction and Service Manual Section CS-B-1.230 for purging mains into service.

Install a marker ball at a new end of main, at a valve, at each ell of a horizontal offset, at road crossings and at any fitting or pressure control identified as needing to be located in the future. Refer to CenterPoint Energy Construction and Service Manual section CS-B-1.310 for installation procedures.



Procedure for tapping or making tie-ins to existing gas mains: Verify existing gas main size, type, and location prior to tapping or making tie-in. Monitor and verify, using a pressure gauge, existing gas main Pressure Class within the bell hole of tap location or tie-in location prior to tapping or making tie-in.

I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the state of Minnesota.

Signature: *Eric Yang*

Typed or Printed Name: **Eric Yang**

Date: **9/15/2025** License Number: **56613**



PROPRIETARY AND CONFIDENTIAL

PROJECT #: **WO #118218168**

CITY: GENOLA

COUNTY: MORRISON

LEGEND:

- IN SERVICE
- PROPOSED
- PROPOSED ABANDONED
- ABANDONED
- NOT A PART OF PROJECT SEE NOTES

PIPE SUMMARY

228' 2" PE CL-6

228' TOTAL PIPE

COPIES:

- PIPELINE INTEGRITY PACKET: N
- STATION MANAGER: N
- DD NUMBER: NA
- CORROSION: NA
- EMP: N

SITE CONTACT: JON STUMPF
PROPERTY OWNER
320-360-0515

SURVEYOR REQUIRED? N

RETURN PACKET TO ENG? N

JOB BRIEFING REQUIRED? N

GFIP #: NA

PERMITS: MORRISON COUNTY

SALES REP: RYAN GOETZ

PROJECT DESCRIPTION: NBCO
JON STUMPF SHOP

DESIGNER: CAMERON VICTOR
PHONE#: 612-321-4436
DRAWN BY: CAMERON VICTOR
DESIGN DATE: 09/13/2025

REVISION INFO:
REV1 - CBV - 9/13/2025
UPDATED ROW TO SHOW
AND MOVED MAIN TO BACK OF
ROW PER MORRISON COUNTY

MAIN

SS#:

SCALE: 1" : 80'

SHEET 1 OF 1