

STEARNS ELECTRIC



ASSOCIATION

CNTY T-R-S: Morrison T127N R30W S24

SUBDIVISION:

SERVICE TYPE: Residential

PERMIT: County

PRI-WIRE: #4 ACSR

RULING SPAN: 0

AMPS: 400

VOLTAGE: 120/240

STAKED BY : LJ

STAKED DATE : 8/29/2025

WO TYPE: NEW CONSTRUCTION

RUS CODE: 101

NAME: KYLE BIENIEK

LOCATION: 230-13-001

SERV LOC: 127591

HOME: (-)

SERVICE AREA: SA2

ACCT: 12759100

MOBILE: (320)333-8810

WO#: 20250761

SHEET : 1 of 6

EXT : 1

DESC: NEW SERVICE / RESIDENTIAL

SUB: S12 F2 Phase B

STATION NO.	POLE H/C	PRIMARY			TRANSFORMERS	GROUND	GUY		ANCHOR	ANGLE	SECONDARY/SERVICE				REMARKS
		SPAN	WIRE	UNITS			UNIT	LEAD			SPAN	WIRE	UNITS	METER	
1	35-6*			A4.1*		H1.1*	E1.1*							- Start Bore	
	35-5			A4.1		H1.1	E1.15L	12	F2.10						
							E1.15L	12	F2.10						
2		1240	1/0 PRI AL URD	UM3-14 UM6-1-1		UM48-1								- Start Bore	
				UM1-5 UM6-10											
				UM6-22 UM27											
3		120	1/0 PRI AL URD											- End Bore	
4		2965	1/0 PRI AL URD	UM1-4 UM6-1-1	UG7 15 kva	UM48-2							(2)UJ2-4	- Extra ground due to distance	
				UM6-34									UJ2-6		
5						UM6-6					30	350 SEC URD	UM8	2SE	

ADDRESS: 30TH ST, BOWLUS

DESIGN COMMENTS:

- BORE ROAD -
- 400 Amp Socket on Panel
- 50ft ROW - Need to be 42-50ft from CL w/ URD along roadway
- Spring of 2026?
- NEED TO FILE COUNTY PERMIT-

Permit Notes: Morrison County Permit# :

WCC COLLECTED: ☐ YES ☐ NO

WCC INCURRED: ☐ YES ☐ NO

ELECTRICIAN:

ELECTRICIAN PH:

RELATED WORK ORDERS:

TITLE: KYLE BIENIEK




CITY LIMITS: NONE

CONDUCTOR TYPE	LINE FEET	WIRES	TOTAL FEET
1/0 PRI AL URD		1	4325
350 SEC URD		1	30



CNTY T-R-S: <u>Morrison T127N R30W S24</u>	PRI-WIRE: <u>#4 ACSR</u>	STAKED BY : <u>LJ</u>	NAME: <u>KYLE BIENIEK</u>	WO#: <u>20250761</u>
SUBDIVISION: _____	RULING SPAN: <u>0</u>	STAKED DATE : <u>8/29/2025</u>	LOCATION: <u>230-13-001</u>	SERVICE AREA: <u>SA2</u>
SERVICE TYPE: <u>Residential</u>	AMPS: <u>400</u>	WO TYPE: <u>NEW CONSTRUCTION</u>	SERV LOC: <u>127591</u>	ACCT: <u>12759100</u>
PERMIT: <u>County</u>	VOLTAGE: <u>120/240</u>	RUS CODE: <u>101</u>	HOME: <u>()-</u>	MOBILE: _____
			DESC: <u>NEW SERVICE / RESIDENTIAL</u>	SUB: <u>S12 F2 Phase B</u>

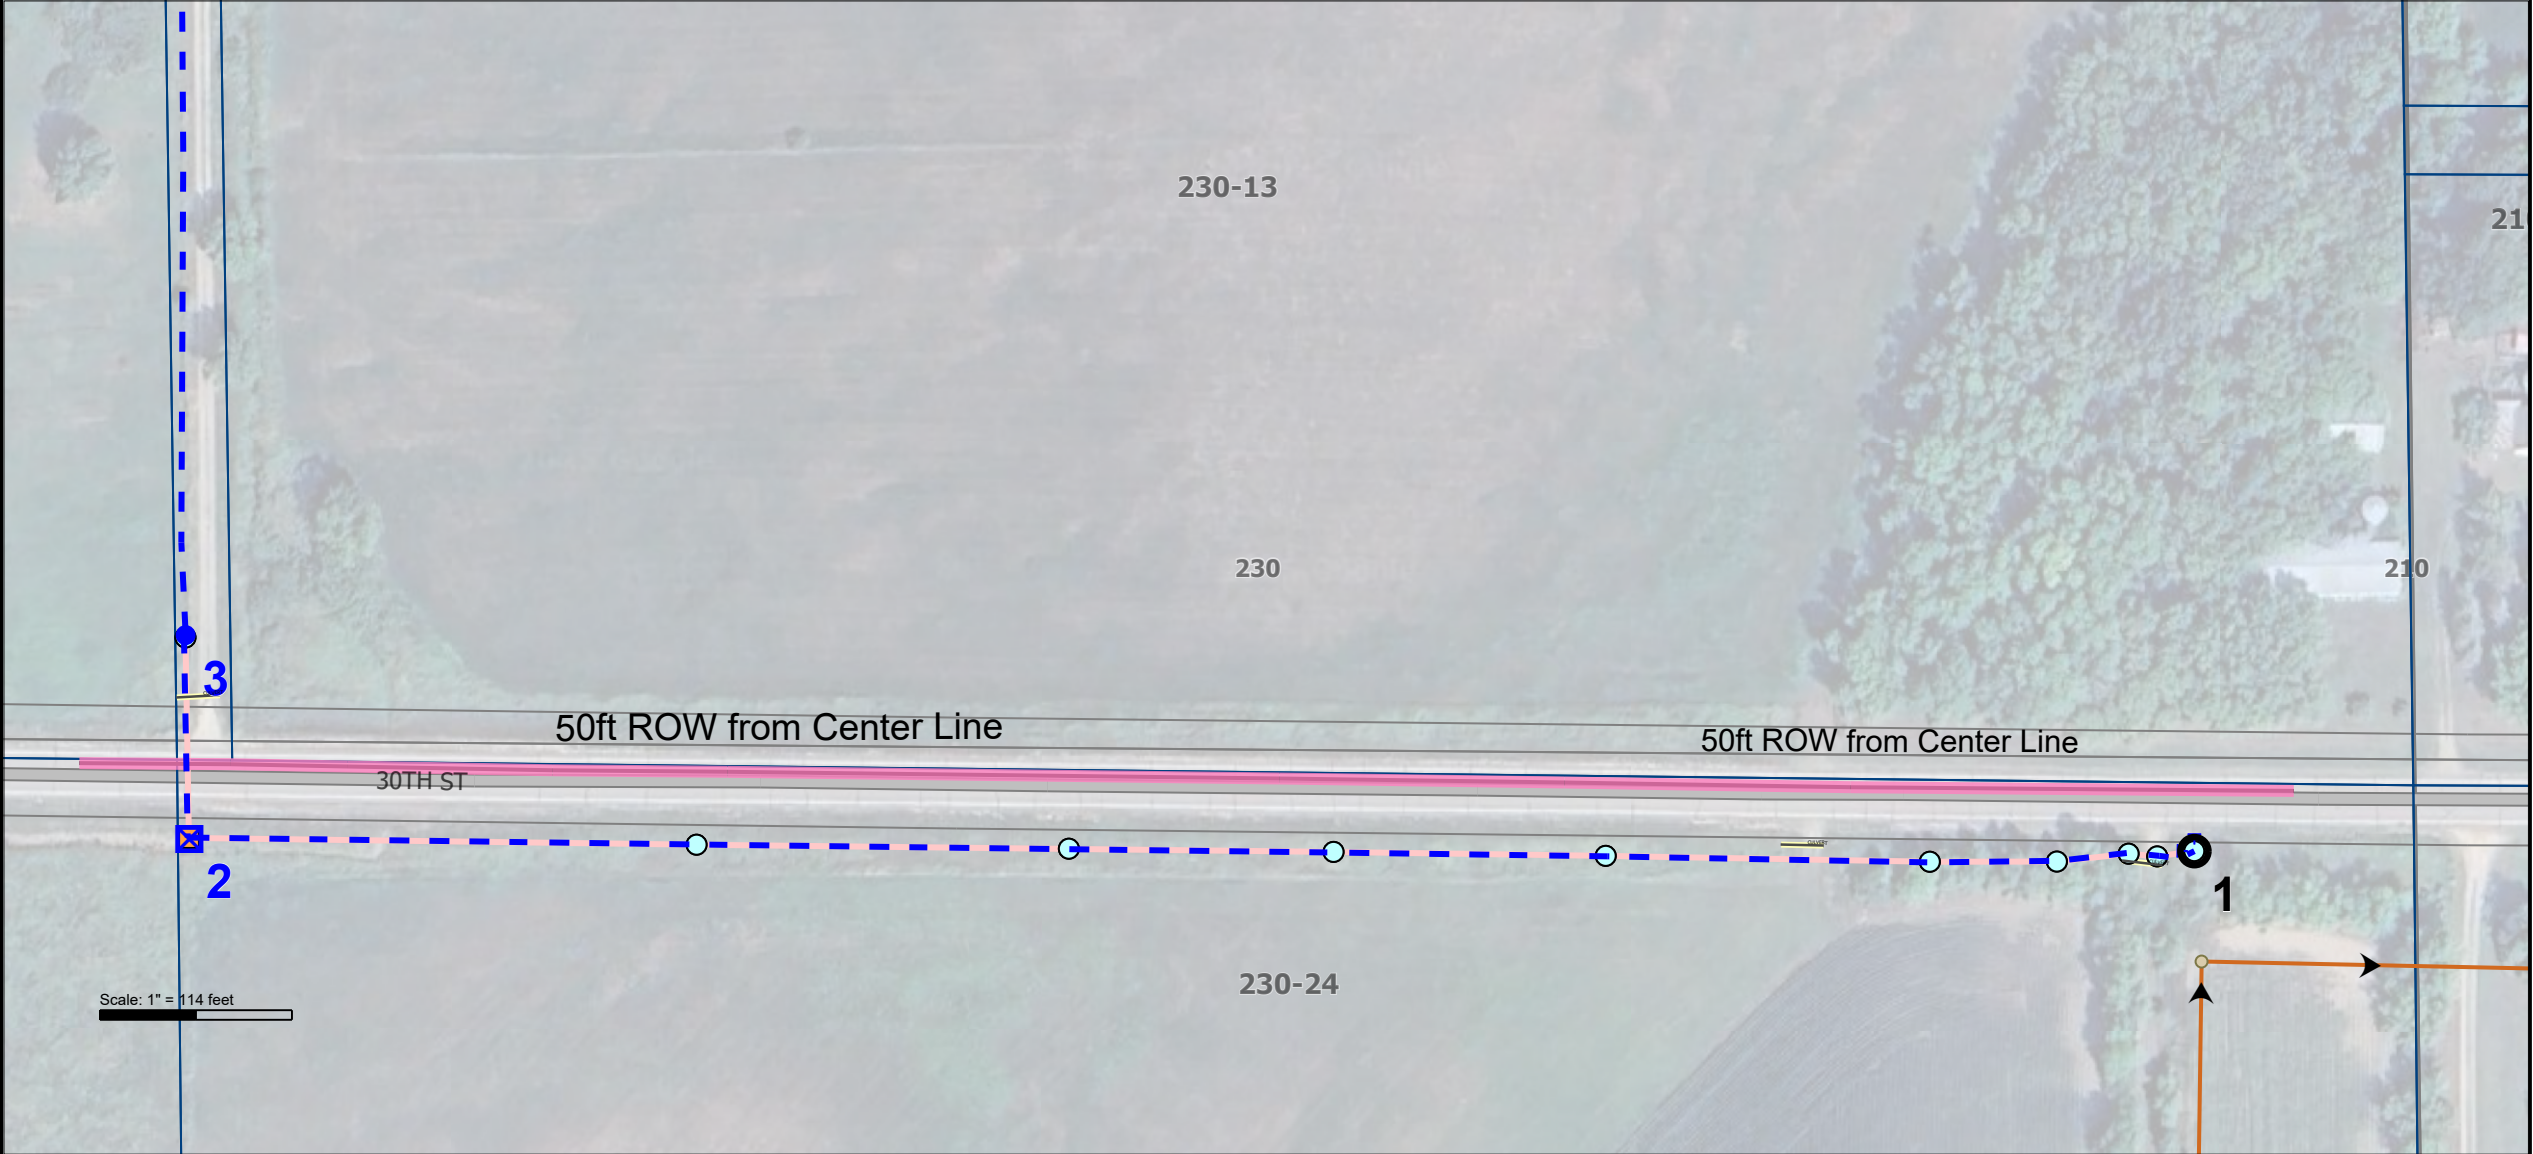


Blue - New Status	Staking Stations	...	Staking Span
Black - Existing Status	Pole	Padmount Transformer	Overhead
Red - Retire Status	Service Point	Primary Cabinet	Underground
		Secondary Pedestal	
		URD Point	





CNTY T-R-S: <u>Morrison T127N R30W S24</u>	PRI-WIRE: <u>#4 ACSR</u>	STAKED BY : <u>LJ</u>	NAME: <u>KYLE BIENIEK</u>	WO#: <u>20250761</u>
SUBDIVISION: _____	RULING SPAN: <u>0</u>	STAKED DATE : <u>8/29/2025</u>	LOCATION: <u>230-13-001</u>	SERVICE AREA: <u>SA2</u>
SERVICE TYPE: <u>Residential</u>	AMPS: <u>400</u>	WO TYPE: <u>NEW CONSTRUCTION</u>	SERV LOC: <u>127591</u>	ACCT: <u>12759100</u>
PERMIT: <u>County</u>	VOLTAGE: <u>120/240</u>	RUS CODE: <u>101</u>	HOME: <u>()-</u>	MOBILE: _____
				SHEET : <u>3 of 6</u> EXT : <u>1</u>
				DESC: <u>NEW SERVICE / RESIDENTIAL</u>
				SUB: <u>S12 F2 Phase B</u>

50ft ROW from Center Line

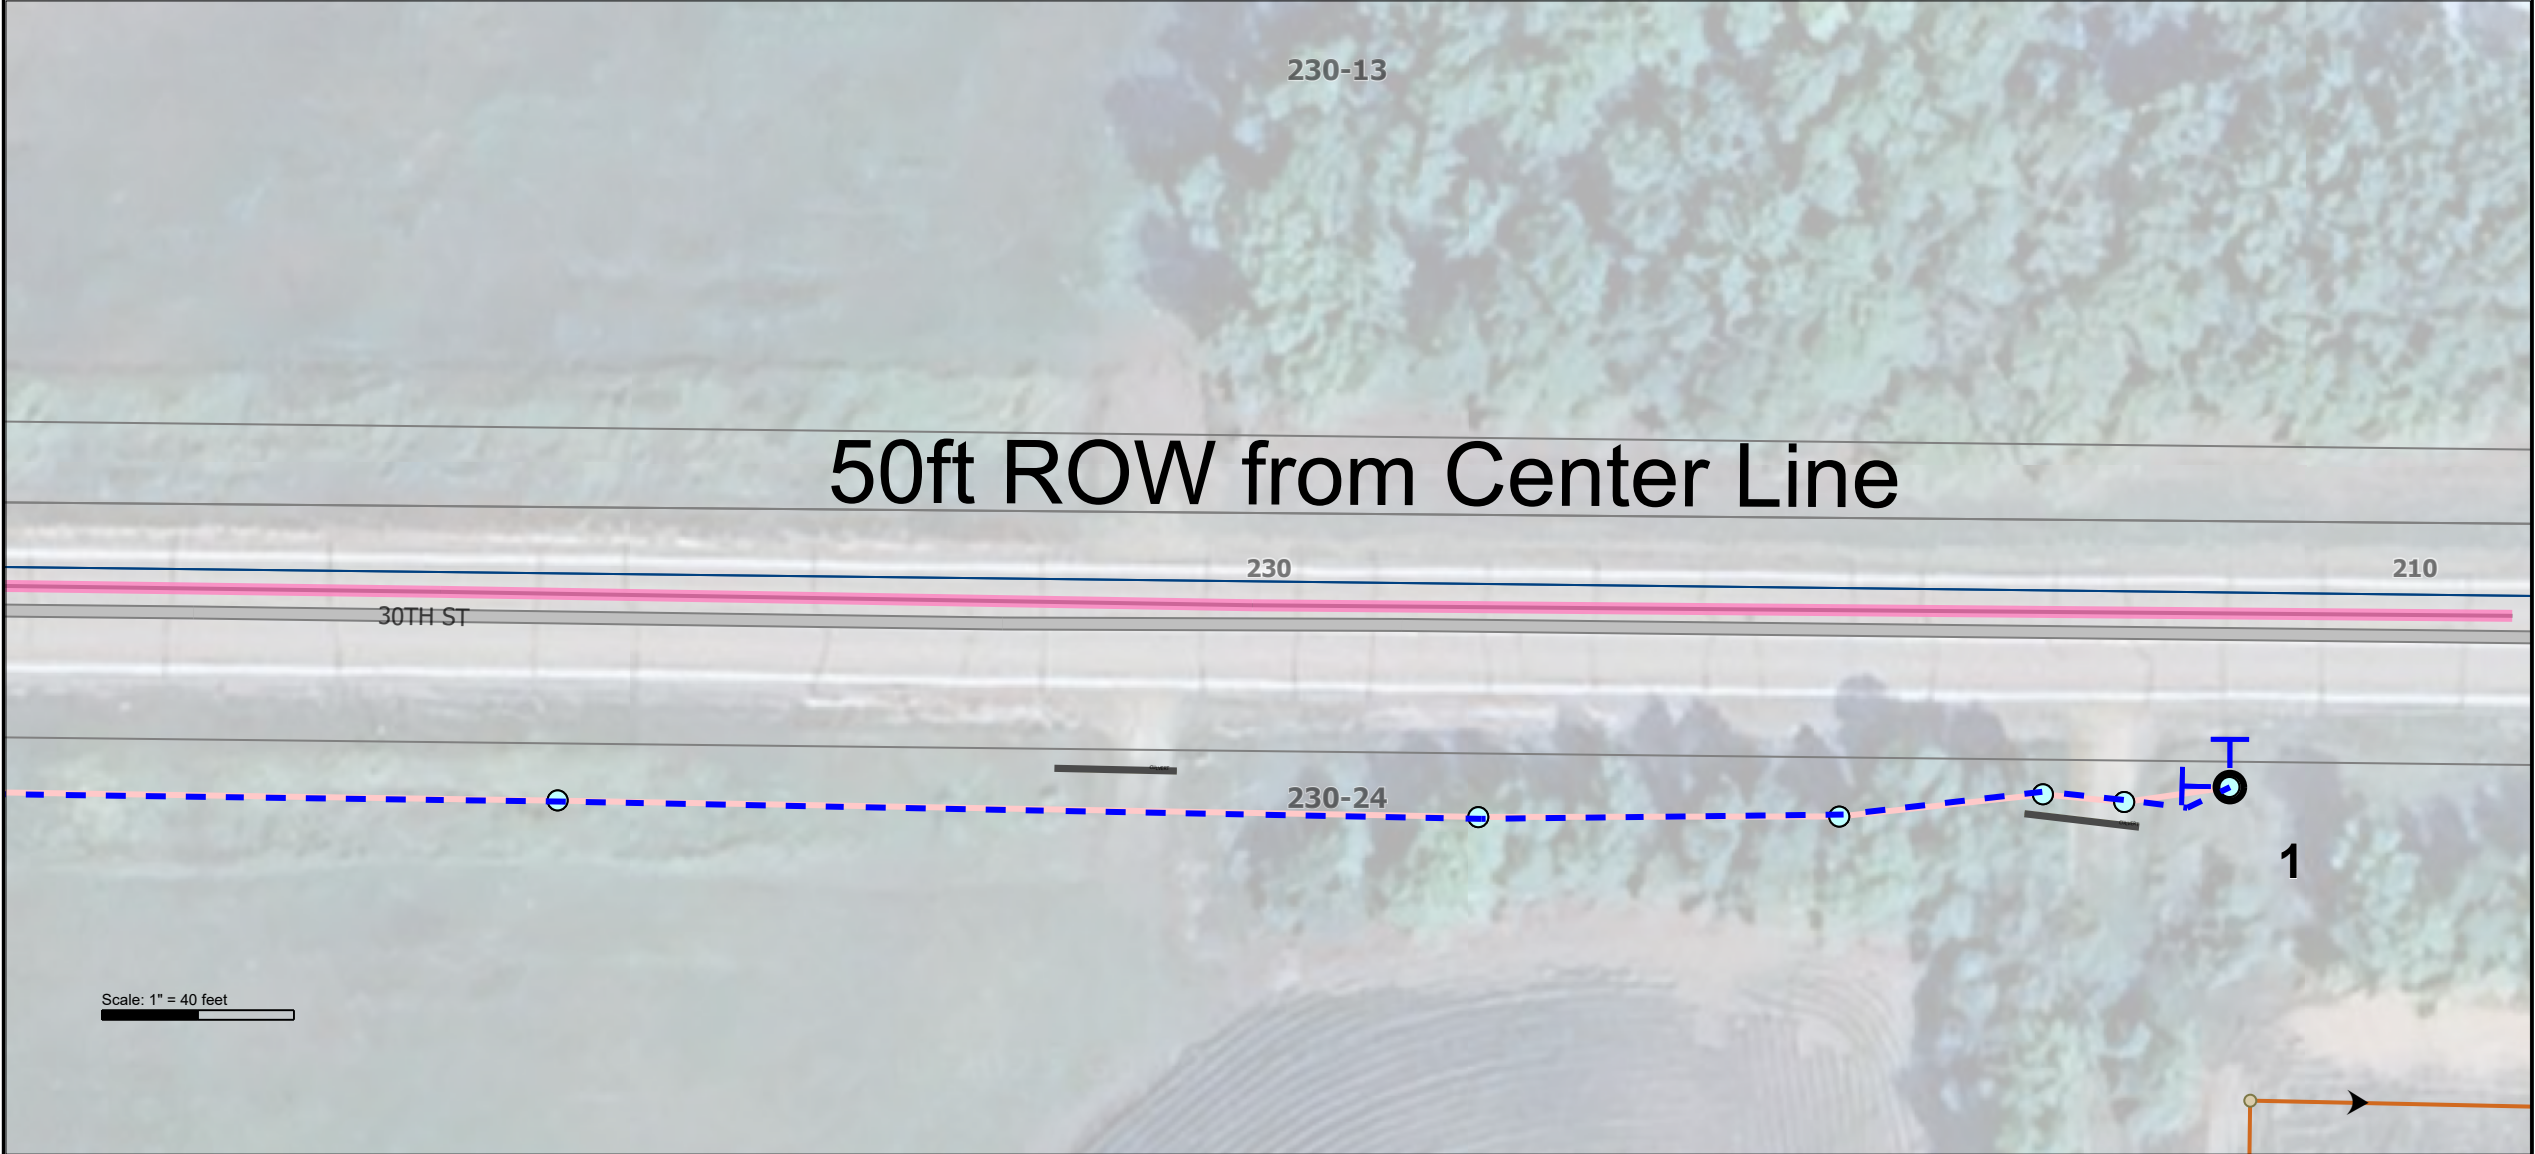

Blue – New Status

Black – Existing Status

Red – Retire Status

Staking Stations

Pole

Service Point

Padmount Transformer

Primary Cabinet

Secondary Pedestal

URD Point


Staking Span

Overhead


Underground





CNTY T-R-S: <u>Morrison T127N R30W S24</u>	PRI-WIRE: <u>#4 ACSR</u>	STAKED BY : <u>LJ</u>	NAME: <u>KYLE BIENIEK</u>	WO#: <u>20250761</u>
SUBDIVISION: _____	RULING SPAN: <u>0</u>	STAKED DATE : <u>8/29/2025</u>	LOCATION: <u>230-13-001</u>	SERVICE AREA: <u>SA2</u>
SERVICE TYPE: <u>Residential</u>	AMPS: <u>400</u>	WO TYPE: <u>NEW CONSTRUCTION</u>	SERV LOC: <u>127591</u>	ACCT: <u>12759100</u>
PERMIT: <u>County</u>	VOLTAGE: <u>120/240</u>	RUS CODE: <u>101</u>	HOME: <u>()-</u>	MOBILE: _____
				SHEET : <u>4 of 6</u> EXT : <u>1</u>
				DESC: <u>NEW SERVICE / RESIDENTIAL</u>
				SUB: <u>S12 F2 Phase B</u>

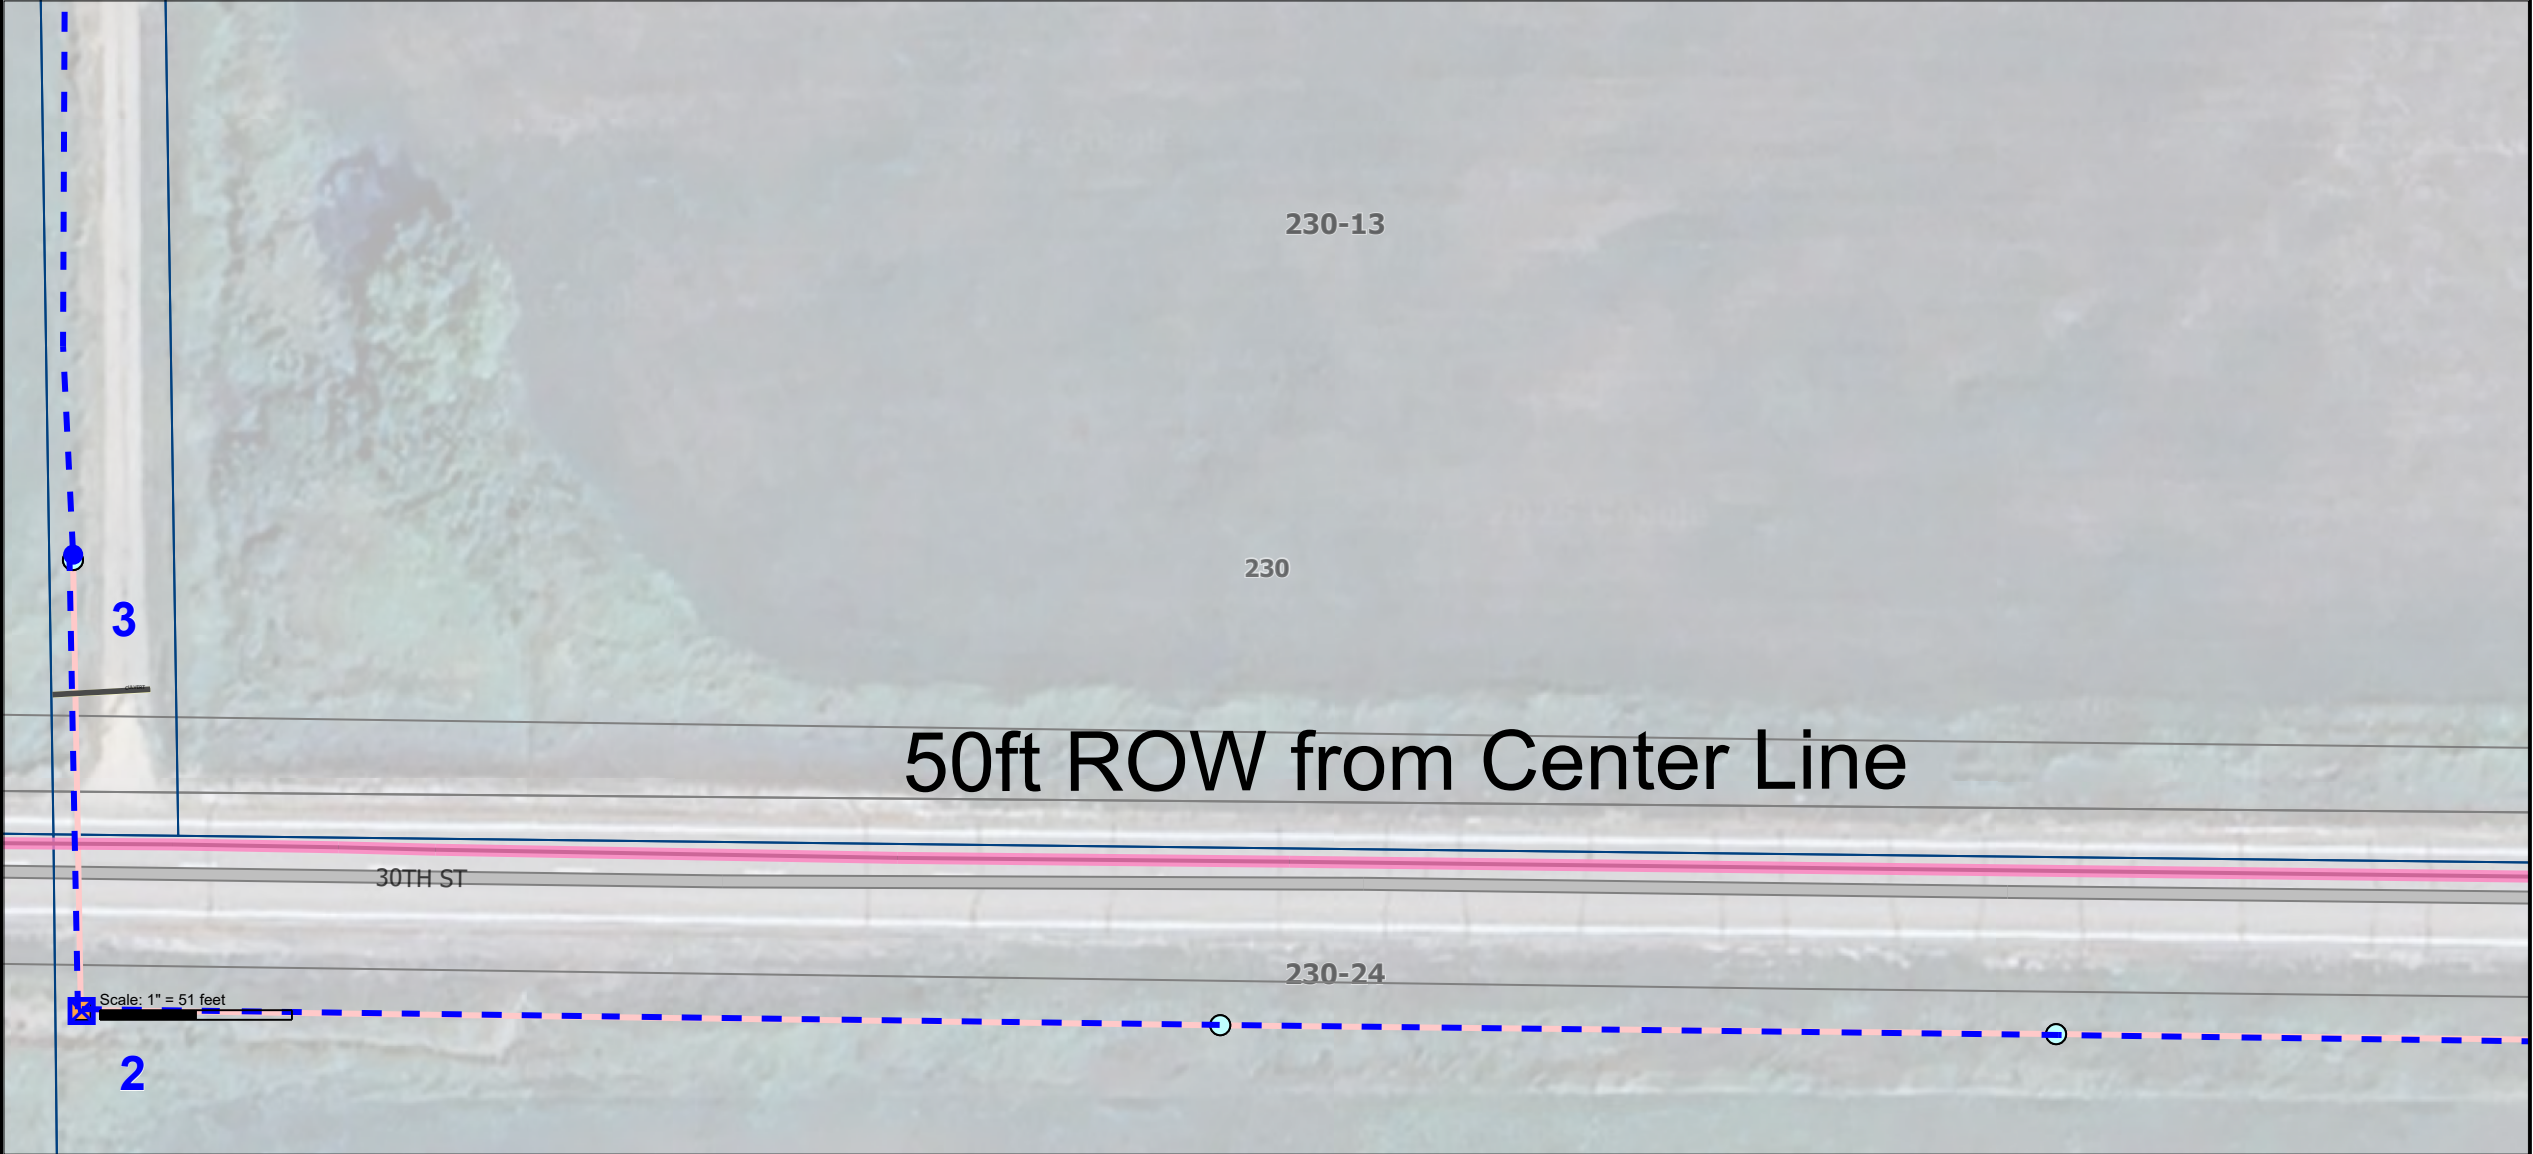


Blue - New Status	Staking Stations	...	Staking Span
Black - Existing Status	Pole	Padmount Transformer	Overhead
Red - Retire Status	Service Point	Primary Cabinet	Underground
		Secondary Pedestal	
		URD Point	



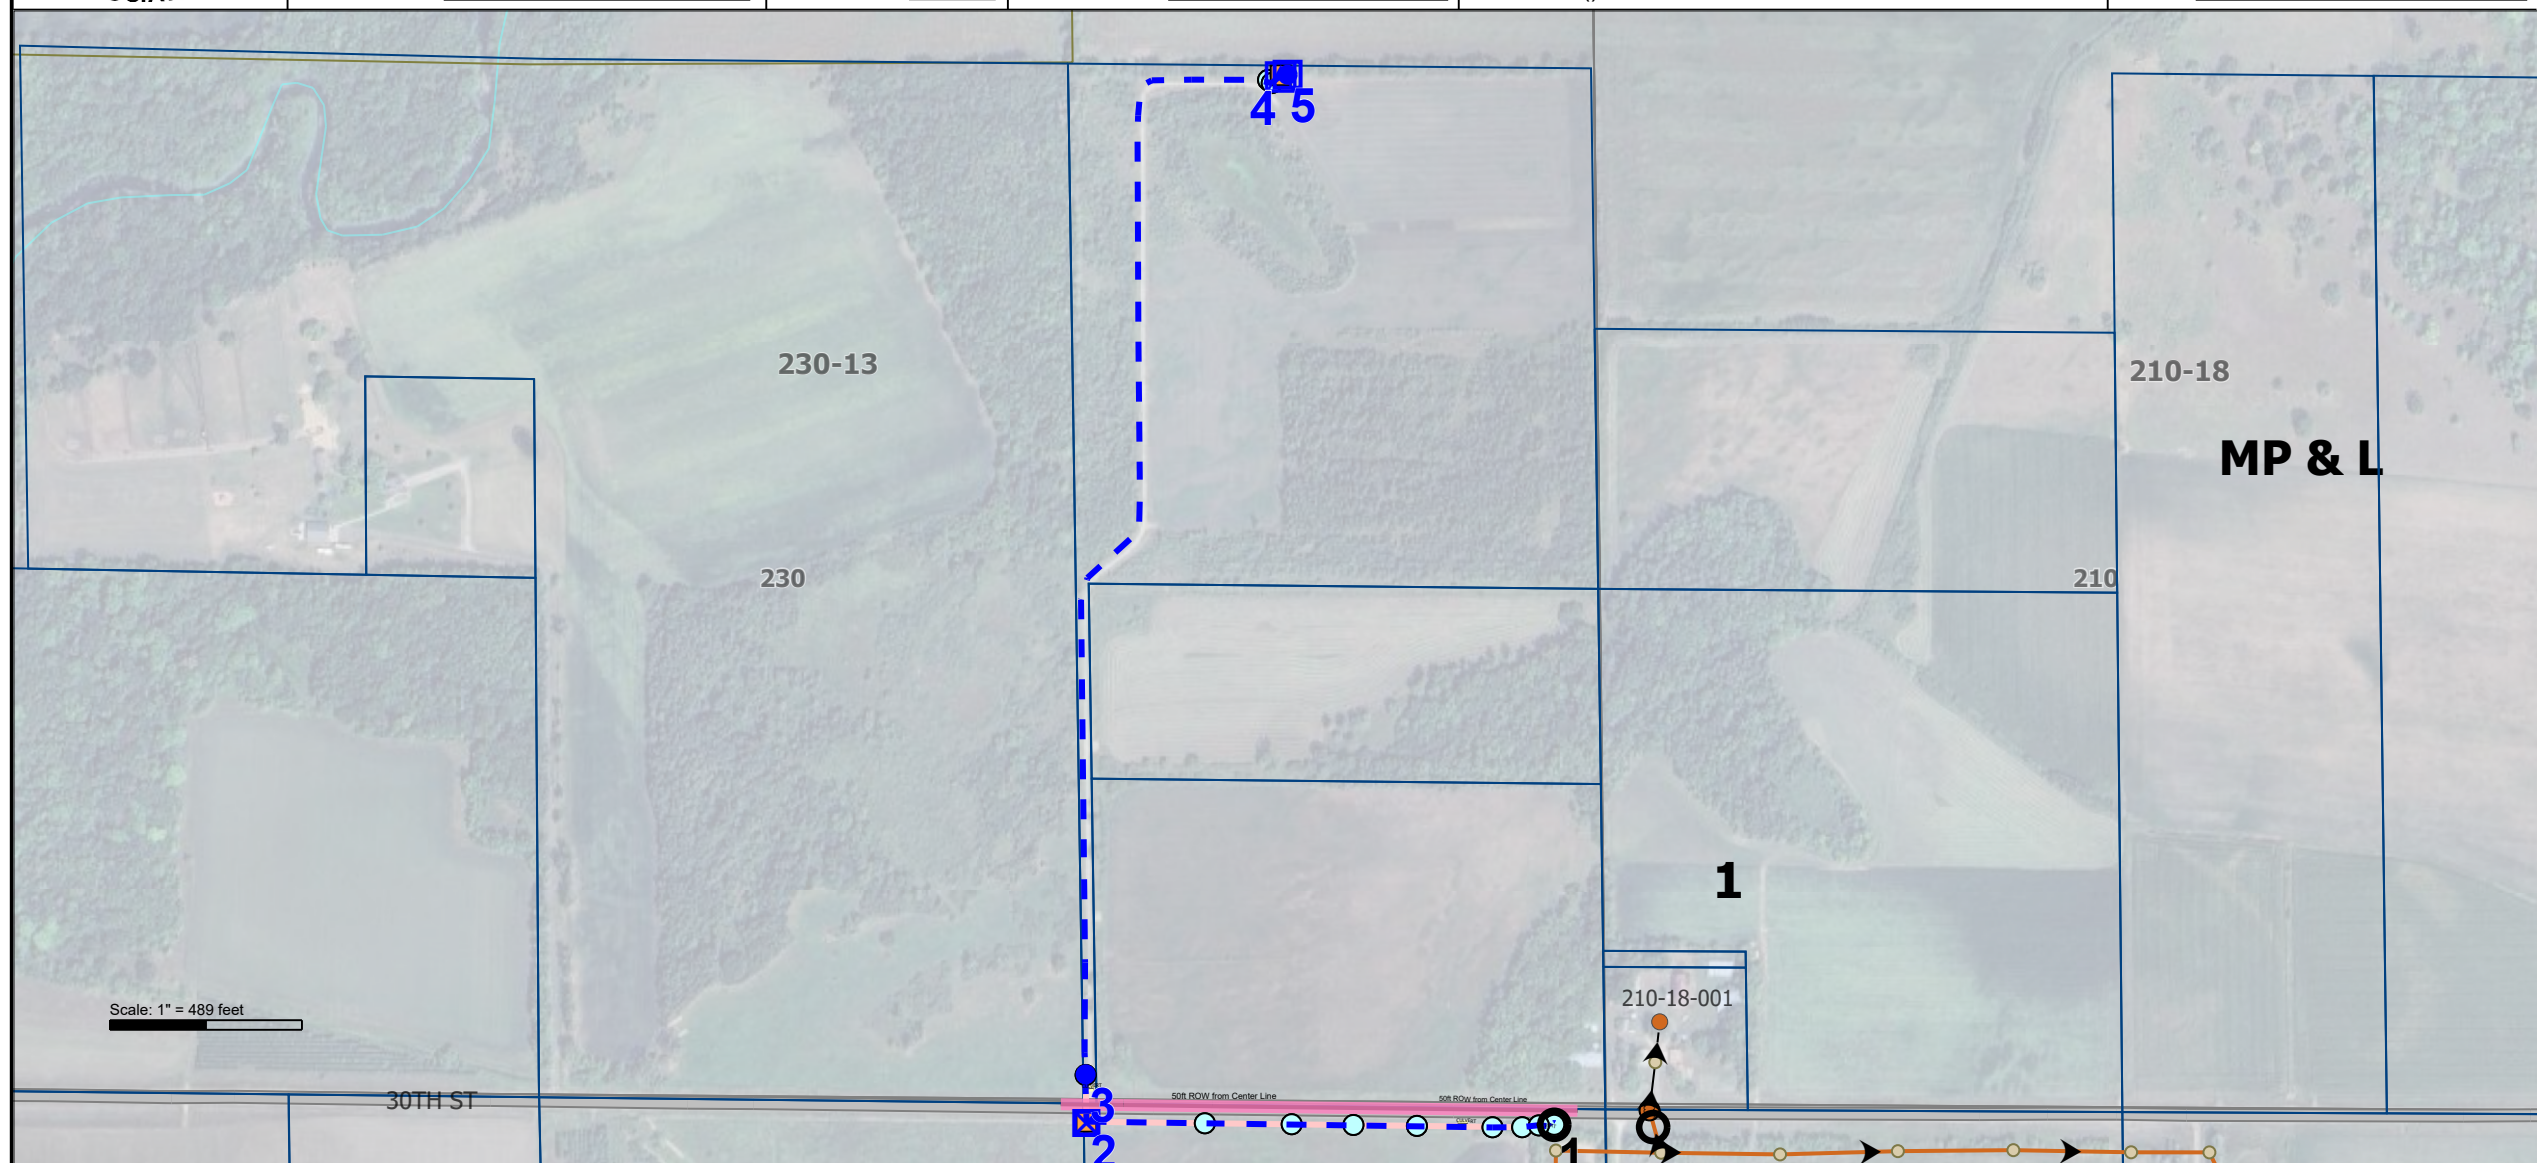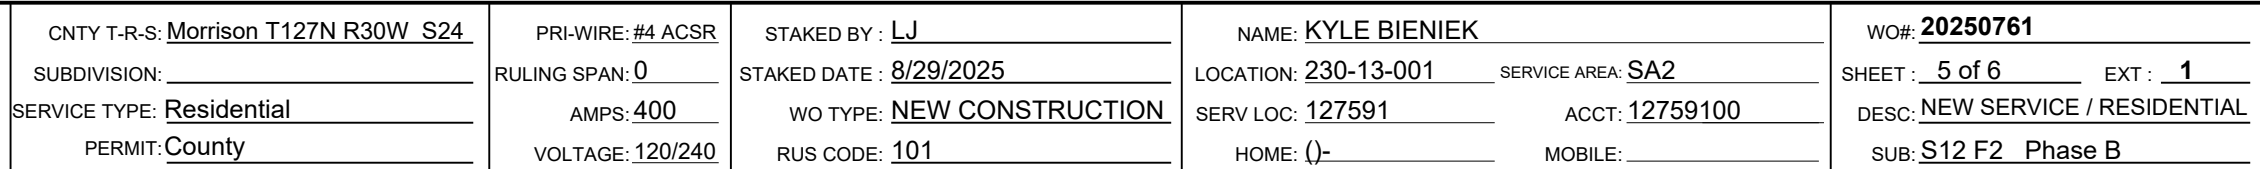



CNTY T-R-S: <u>Morrison T127N R30W S24</u>	PRI-WIRE: <u>#4 ACSR</u>	STAKED BY : <u>LJ</u>	NAME: <u>KYLE BIENIEK</u>	WO#: <u>20250761</u>
SUBDIVISION: _____	RULING SPAN: <u>0</u>	STAKED DATE : <u>8/29/2025</u>	LOCATION: <u>230-13-001</u> SERVICE AREA: <u>SA2</u>	SHEET : <u>6 of 6</u> EXT : <u>1</u>
SERVICE TYPE: <u>Residential</u>	AMPS: <u>400</u>	WO TYPE: <u>NEW CONSTRUCTION</u>	SERV LOC: <u>127591</u> ACCT: <u>12759100</u>	DESC: <u>NEW SERVICE / RESIDENTIAL</u>
PERMIT: <u>County</u>	VOLTAGE: <u>120/240</u>	RUS CODE: <u>101</u>	HOME: <u>()-</u> MOBILE: _____	SUB: <u>S12 F2 Phase B</u>

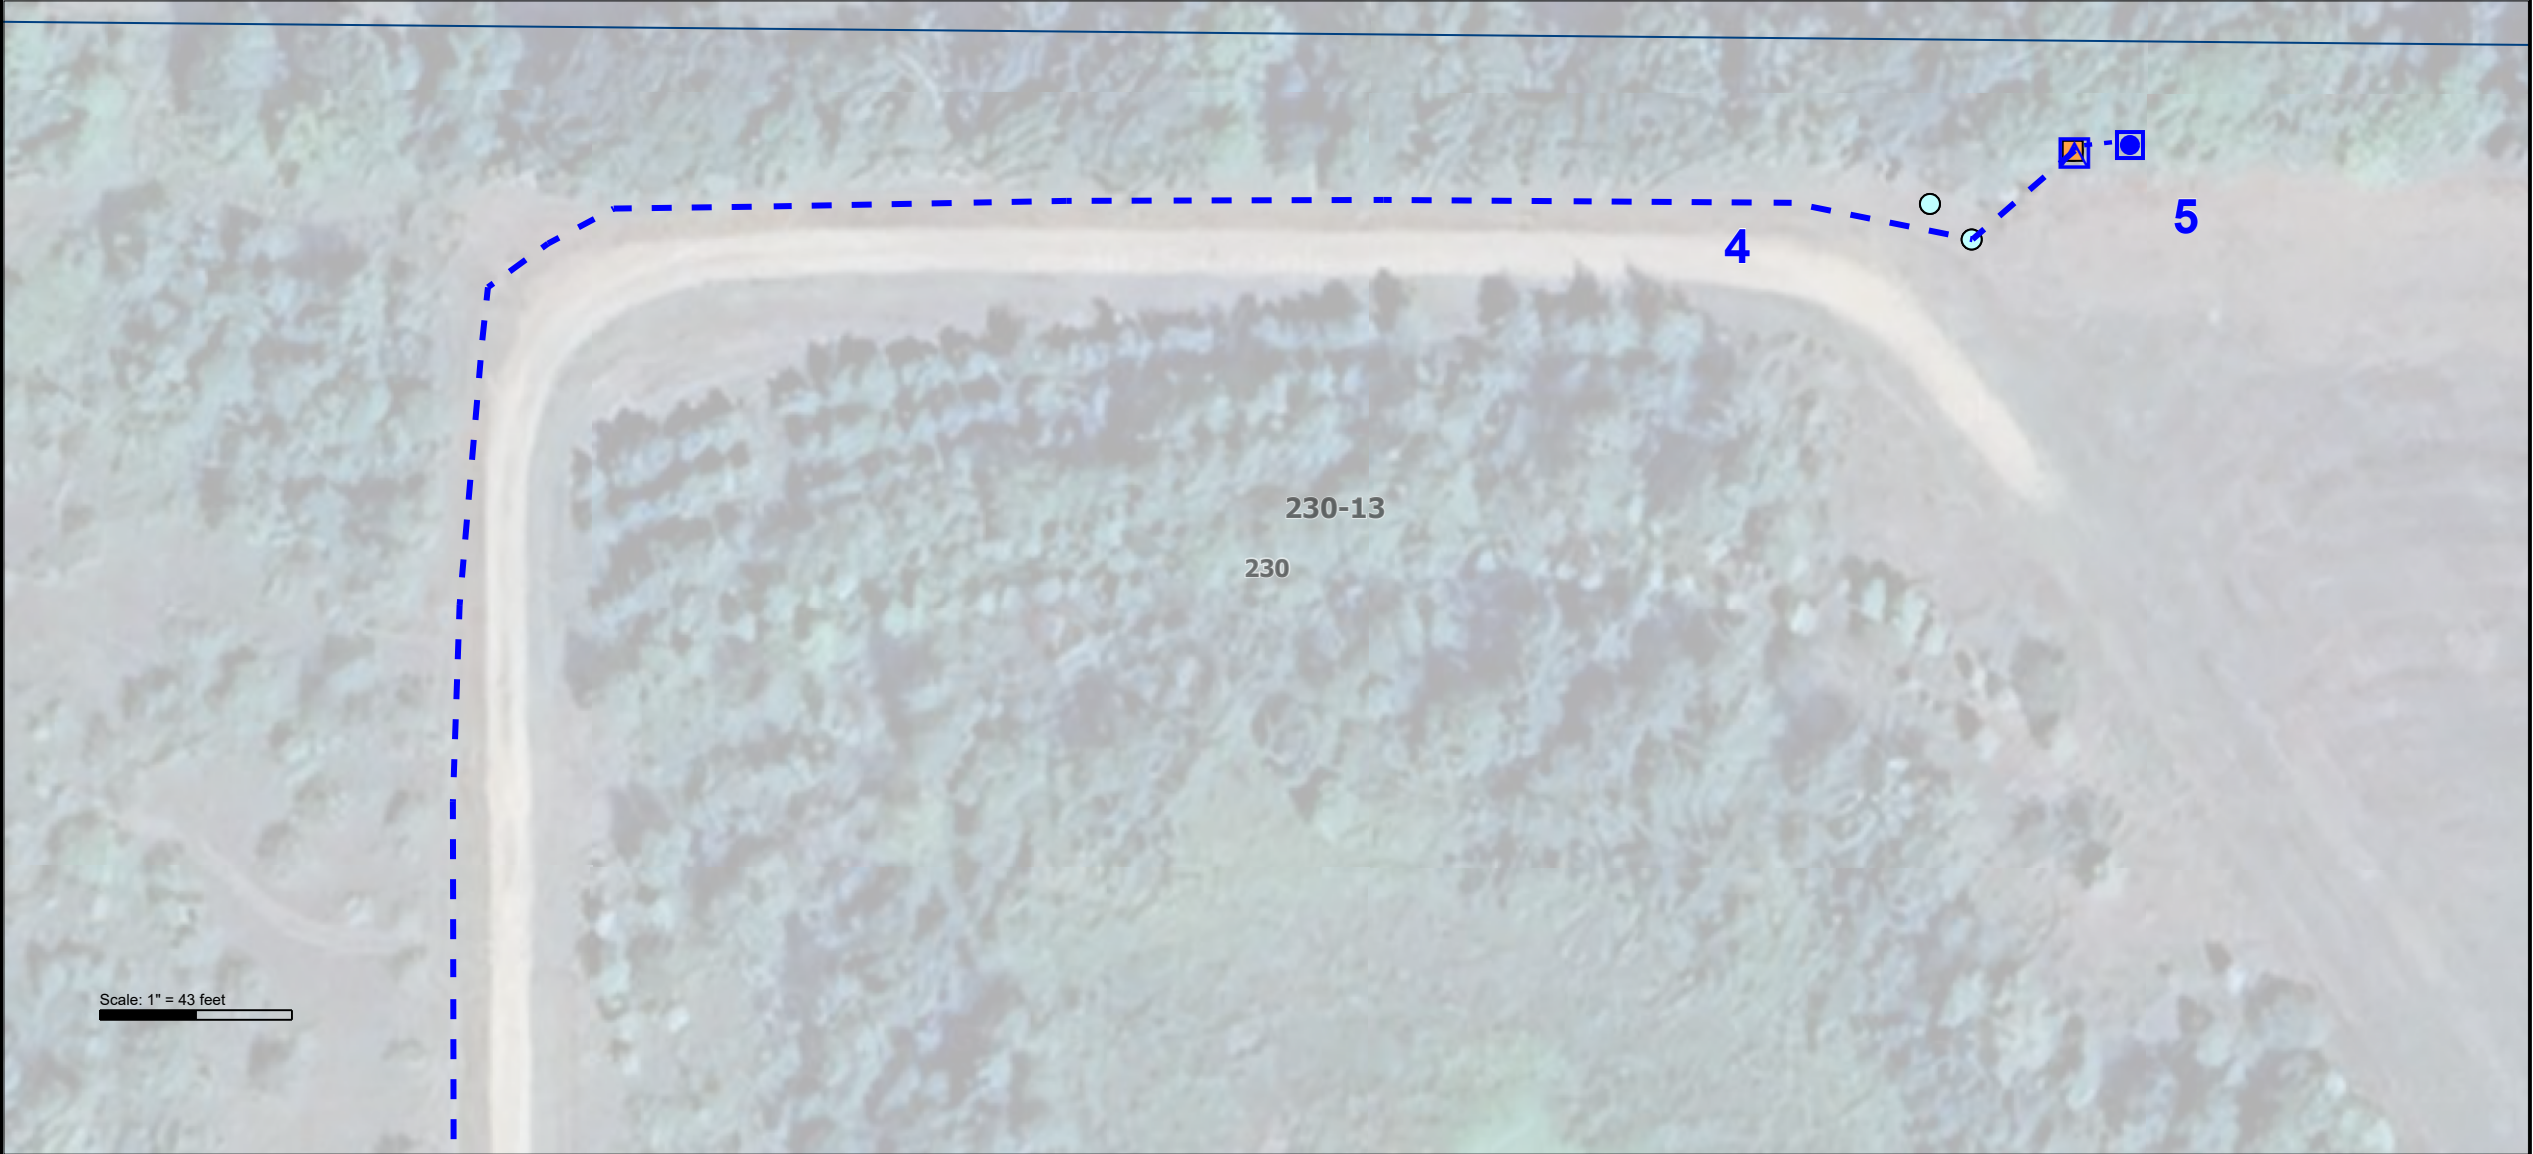

Blue – New Status	Staking Stations	...	Staking Span
Black – Existing Status	Pole	Padmount Transformer	Overhead
Red – Retire Status	Service Point	Primary Cabinet	Underground
		Secondary Pedestal	
		URD Point	

